


Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed April 29, 2014

Section 1  
NLH System Island Interconnected Supply and Demand  
Actual 24 Hour System Performance For April 28, 2014

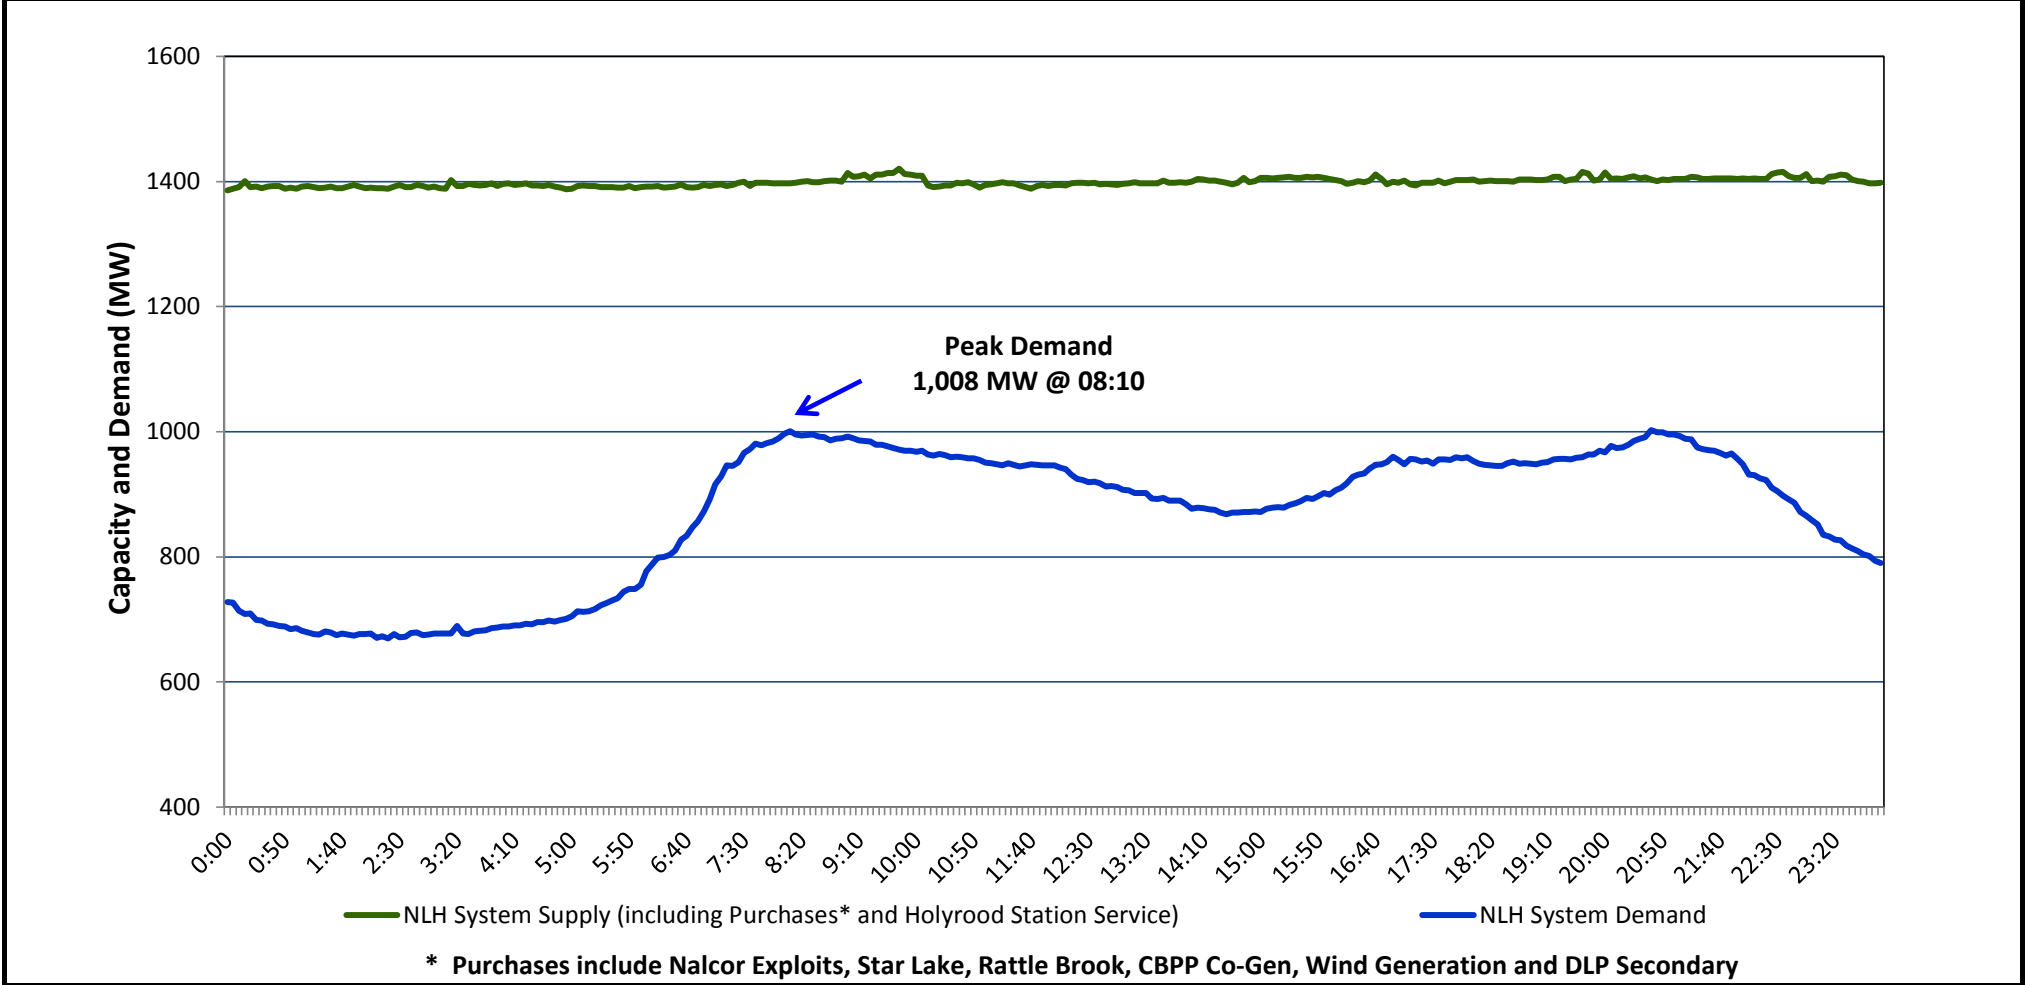

**Supply Notes for April 28, 2014**

→ As of 0422 hours, Feb. 17, 2014, Bay d'Espoir Unit 6 (77 MW) unavailable for service.

→ As of 1717 hours, April 10, 2014, Holyrood Unit 3 removed from service for annual maintenance (150 MW).

→ As of 1055 hours, April 14, 2014, Bay d'Espoir Unit 2 removed from service for annual maintenance (77 MW).

→ As of 1030 hours, April 24, 2014, Holyrood Unit 1 derated to 162 MW (from 170 MW).

→ As of 1140 hours, April 24, 2014, Holyrood Unit 2 derated to 156 MW (from 165 MW).

Section 2  
NLH System Island Interconnected Supply and Demand

April 29, 2014    NLH System Outlook <sup>3</sup>			Five-Day Forecast	Temperature (°C)		NLH System Demand (MW)	
				Morning	Evening	Morning	Evening
Available NLH System Supply: <sup>4</sup>	1,330	MW	Tuesday, April 29, 2014	1	0	1,100	975
Current St. John's Temperature:	0	°C	Wednesday, April 30, 2014	-1	-2	1,025	975
Current St. John's Windchill:	-8	°C	Thursday, May 01, 2014	-2	2	975	950
NLH System Peak Demand Forecast:	1,100	MW	Friday, May 02, 2014	-2	6	1,025	875
			Saturday, May 03, 2014	1	8	925	825

**Supply Notes for April 29, 2014<sup>3</sup>**

→

Notes:

1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
3. As of 0800 Hours.
4. Gross output including station service at Holyrood (24.5 MW) and improved hydraulic output due to water levels (35 MW). Includes Nalcor Exploits, Star Lake, Rattle Brook, CBPP Co-Gen. Excludes wind generation and DLP Secondary.

Section 3  
Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak

April 28, 2014	Actual NLH System Island Interconnected Peak Demand <sup>1</sup>	08:10	1,008 MW
April 29, 2014	Forecast NLH System Island Interconnected Peak Demand		1,100 MW
April 28, 2014	Actual Total Island Peak Demand <sup>2</sup>	08:35	1,165 MW
April 29, 2014	Forecast Total Island Peak Demand		1,250 MW

Notes:

1. NLH System Island Interconnected is supplied by generation owned by NLH as well as NLH Power Purchases as detailed in Section 1 above.
2. Total Island System Demand is supplied by NLH generation and NLH Power Purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper to meet their respective supply needs.