
Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Monday, March 02, 2015

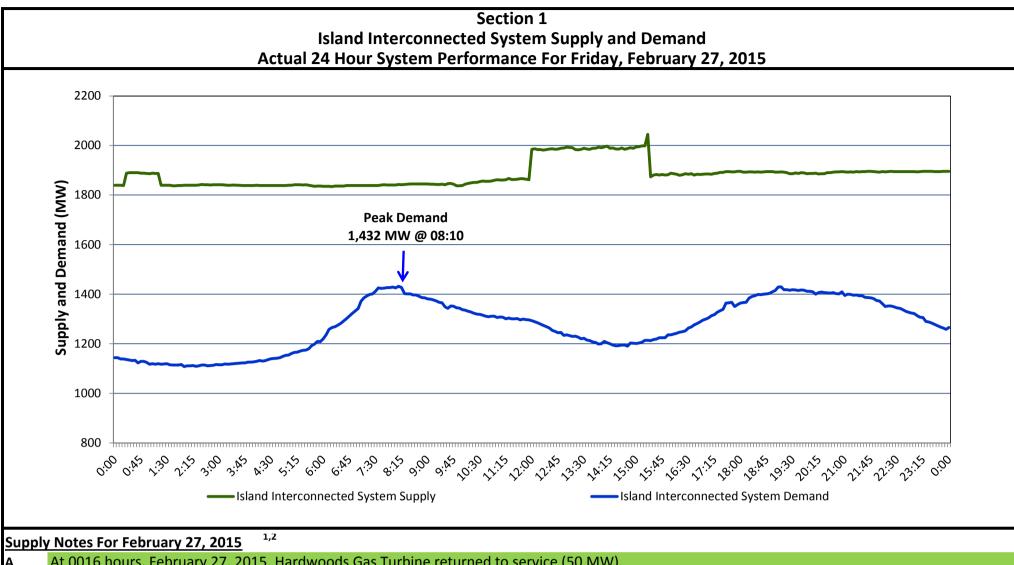

- At 0016 hours, February 27, 2015, Hardwoods Gas Turbine returned to service (50 MW).
 - At 0113 hours, February 27, 2015, Hardwoods Gas Turbine tripped offline (50 MW).
- At 1200 hours, February 27, 2015, Holyrood Combustion Turbine capacity available to the Island System (123.5 MW).
- At 1518 hours, February 27, 2015, Hardwoods Gas Turbine returned to service (50 MW).
- At 1522 hours, February 27, 2015, Holyrood Unit 1 removed from service (170 MW).

Section 2 Island Interconnected Supply and Demand									
Sat, Feb 28, 2015 Island System Outlook ³		Seven-Day Forecast		Temperature (°C)		Island System Daily Peak Demand (MW)			
				Morning	Evening	Forecast	Adjusted ⁶		
Available Island System Supply:5	1,865	MW	Saturday, February 28, 2015	-12	-10	1,550	1,450		
NLH Generation: ⁴	1,525	MW	Sunday, March 01, 2015	-8	-7	1,465	1,370		
NLH Power Purchases:	125	MW	Monday, March 02, 2015	-5	-1	1,445	1,350		
Other Island Generation:	215	MW	Tuesday, March 03, 2015	-2	-9	1,545	1,445		
Current St. John's Temperature:	-12	°C	Wednesday, March 04, 2015	-10	-2	1,560	1,460		
Current St. John's Windchill:	-22	°C	Thursday, March 05, 2015	-1	-4	1,355	1,260		
7-Day Island Peak Demand Forecast:	1,560	MW	Friday, March 06, 2015	-8	-9	1,520	1,420		

Supply Notes For February 28, 2015

- Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 - 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 - 3. As of 0800 Hours.
 - 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 - 5. Gross output from all Island sources (including Note 4).
 - 6. Adjusted for CBP&P interruptible load (when applicable) and the impact of voltage reduction.

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak							
Fri, Feb 27, 2015	Actual Island Peak Demand ⁷	08:10	1,432 MW				
Sat, Feb 28, 2015	Forecast Island Peak Demand		1,550 MW				

Notes: 7. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).