


Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Tuesday, July 14, 2015

Section 1
Island Interconnected System Supply and Demand
Actual 24 Hour System Performance For Saturday, July 11, 2015

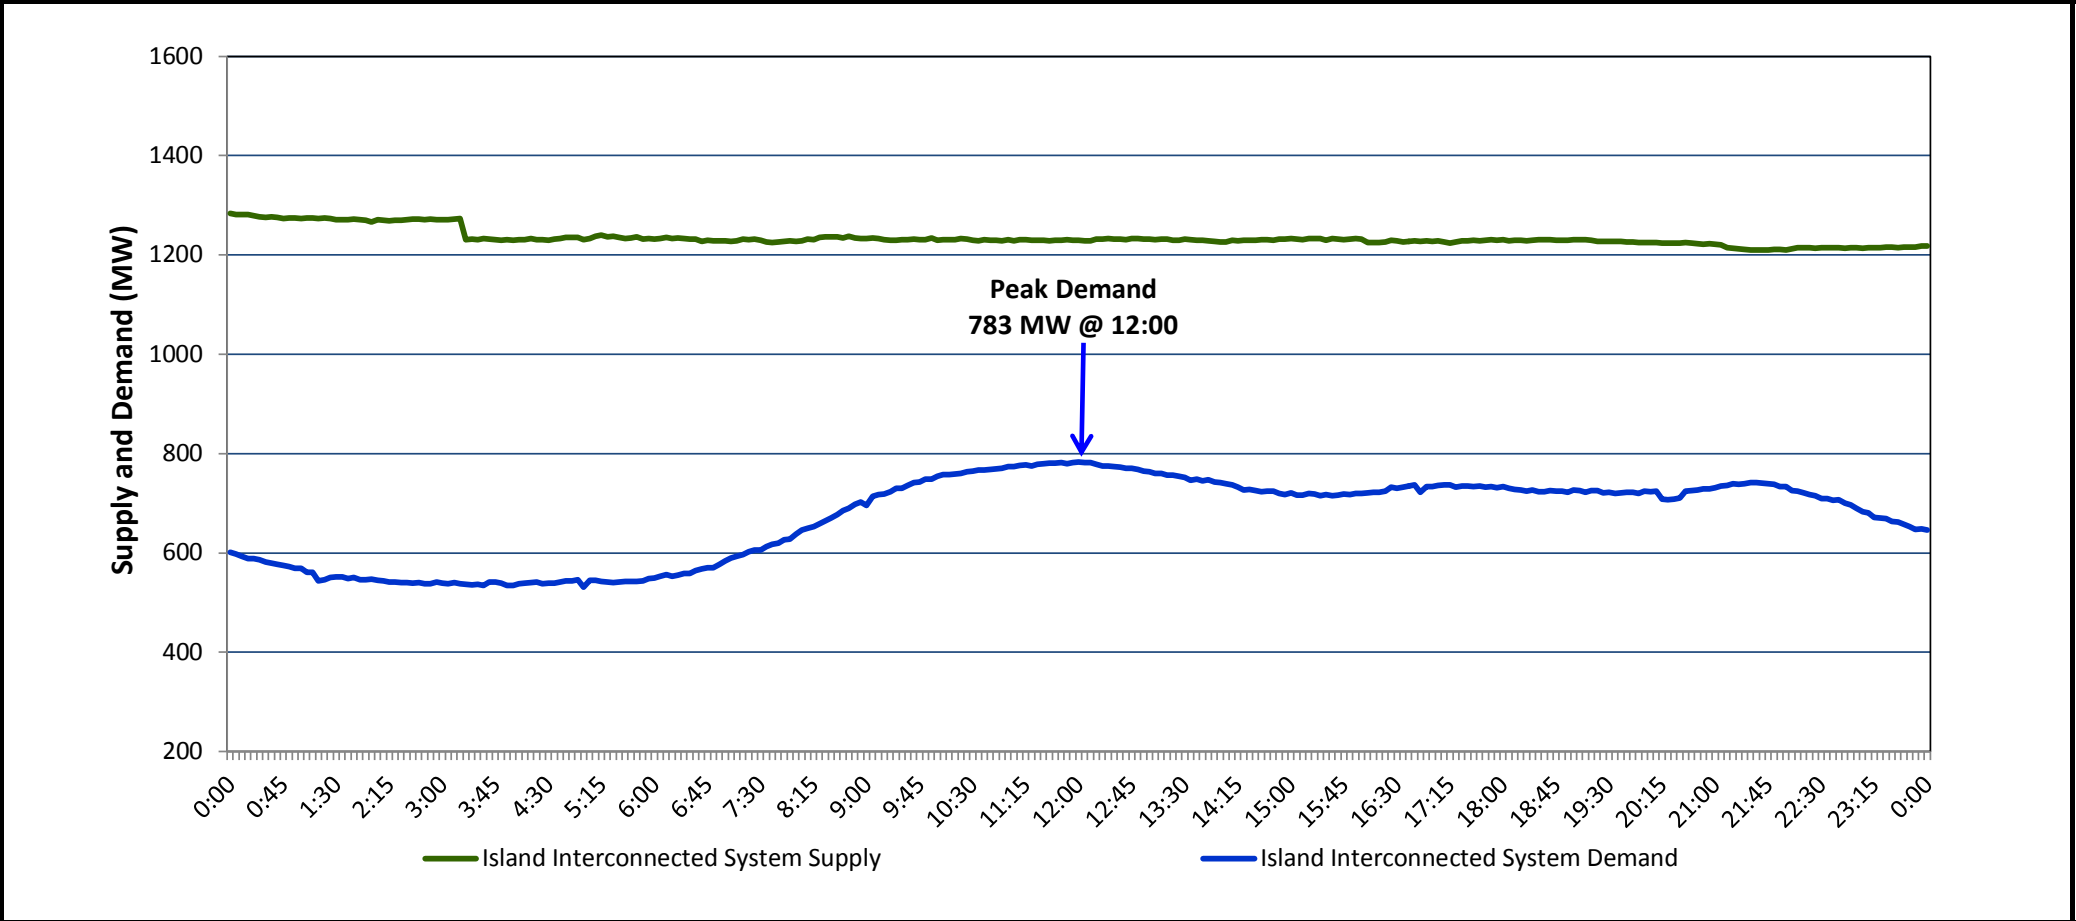

Supply Notes For July 11, 20151,2

A

As of 1823 hours, March 01, 2015, Hardwoods Gas Turbine End B unavailable (25 MW).

B

As of 1333 hours, April 10, 2015, Holyrood Unit 3 removed from service for annual maintenance (150 MW).

C

As of 0808 hours, May 27, 2015, Bay d'Espoir Unit 5 removed from service for annual maintenance (76.5 MW).

D

As of 0808 hours, May 27, 2015, Bay d'Espoir Unit 6 removed from service for annual maintenance (76.5 MW).

E

As of 0824 hours, May 29, 2015, Hardwoods Gas Turbine End A unavailable (25 MW).

F

As of 1440 hours, June 06, 2015, Holyrood Unit 2 removed from service for annual maintenance (170 MW).

G

As of 1450 hours, June 24, 2015, Hawke's Bay Unit 548 (G2) unavailable (2.5 MW).

H

As of 0819 hours, July 06, 2015, Nalcor Exploits Unit 4 unavailable (30 MW). Net impact to Island System is 4 MW.

I

As of 0842 hours, July 06, 2015, Cat Arm Unit 1 unavailable (67 MW).

J

As of 1810 hours, July 08, 2015, Bay d'Espoir Unit 1 de-rated to 45 MW (76.5 MW).

K

As of 0839 hours, July 10, 2015, Cat Arm Unit 2 unavailable (67 MW).

L

At 0319 hours, July 11, 2015, Granite Canal Unit unavailable (40 MW).

Section 2
Island Interconnected Supply and Demand

Sun, Jul 12, 2015	Island System Outlook ³		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)
				Morning	Evening	
Available Island System Supply: ⁵	1,240	MW	Sunday, July 12, 2015	8	12	795
NLH Generation: ⁴	960	MW	Monday, July 13, 2015	12	15	795
NLH Power Purchases:	85	MW	Tuesday, July 14, 2015	15	18	775
Other Island Generation:	195	MW	Wednesday, July 15, 2015	15	17	770
Current St. John's Temperature:	9	°C	Thursday, July 16, 2015	18	16	765
Current St. John's Windchill:	N/A	°C	Friday, July 17, 2015	14	14	780
7-Day Island Peak Demand Forecast:	795	MW	Saturday, July 18, 2015	13	14	755

Supply Notes For July 12, 20153

Notes:

1.

Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.

2.

Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.

3.

As of 0800 Hours.

4.

Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).

5.

Gross output from all Island sources (including Note 4).

Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak

Sat, Jul 11, 2015	Actual Island Peak Demand ⁷	12:00	783 MW
Sun, Jul 12, 2015	Forecast Island Peak Demand		795 MW

Notes:

7.

Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).