
Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Wednesday, February 10, 2016

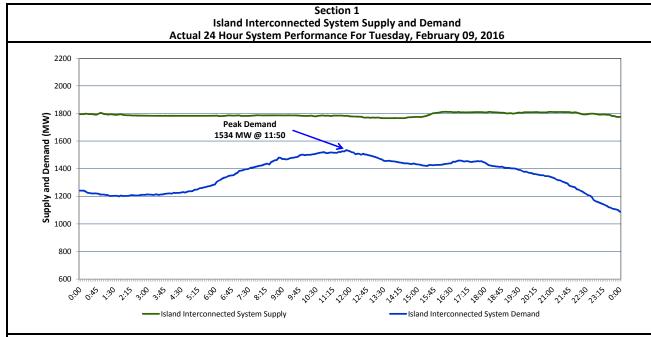

Supply Notes For February 09, 2016

- As of 1956 hours, January 14, 2016, Nalcor Exploits Grand Falls Unit 7 unavailable. No net impact to the Island Interconnected System.
- As of 1116 hours, February 07, 2016, Holyrood Unit 1 derated to 50 MW (170 MW).
- c As of 0710 hours, February 08, 2016, Holyrood Unit 2 derated to 120 MW (170 MW).
- As of 1524 hours, February 08, 2016, Hardwoods Gas Turbine End A unavailable (25 MW).

Section 2 Island Interconnected Supply and Demand									
Wed, Feb 10, 2016 Island System Outlook ³		Seven-Day Forecast		Temperature (°C)		Island System Daily Peak Demand (MW)			
				Morning	Evening	Forecast	Adjusted ⁶		
Available Island System Supply:	⁵ 1,760	MW	Wednesday, February 10, 2016	3	-2	1,415	1,318		
NLH Generation: ⁴	1,475	MW	Thursday, February 11, 2016	-4	-4	1,430	1,333		
NLH Power Purchases: ⁷	85	MW	Friday, February 12, 2016	-4	-4	1,410	1,314		
Other Island Generation:	200	MW	Saturday, February 13, 2016	-6	-4	1,380	1,284		
Current St. John's Temperature	: 0	°C	Sunday, February 14, 2016	0	-6	1,420	1,323		
Current St. John's Windchill:	N/A	°C	Monday, February 15, 2016	-7	-8	1,530	1,432		
7-Day Island Peak Demand For	ecast: 1,530	MW	Tuesday, February 16, 2016	-5	2	1,440	1,343		

Supply Notes For February 10, 2016

At 0625 hours, February 10, 2016, Stephenville Gas Turbine End B unavailable (25 MW)

- otes: 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 - 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 - 3. As of 0800 Hours.
 - 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 - 5. Gross output from all Island sources (including Note 4).
 - 6. Adjusted for CBP&P interruptible load (when applicable) and the impact of voltage reduction.
 - 7. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Vale capacity assistance, and Wind Generation.

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak							
Tue, Feb 09, 2016	Actual Island Peak Demand ⁸	11:50	1,534 MW				
Wed, Feb 10, 2016	Forecast Island Peak Demand		1,415 MW				

Notes: 8. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).