
Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Friday, May 20, 2016

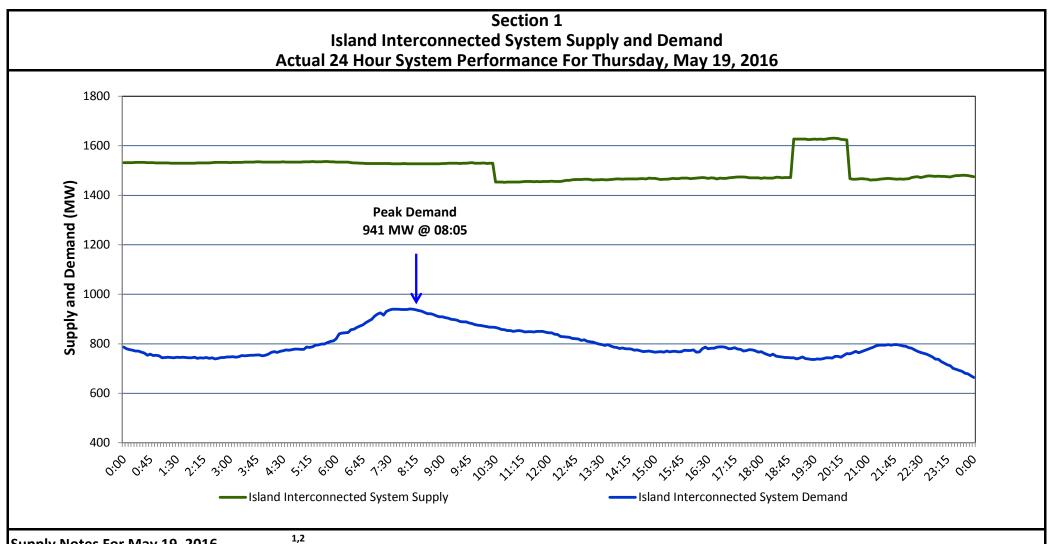

Supply Notes For May 19, 2016

- As of 1956 hours, January 14, 2016, Nalcor Exploits Grand Falls Unit 7 unavailable. No net impact to the Island Interconnected System.
- As of 0732 hours, February 29, 2016, Hardwoods Gas Turbine derated to 38 MW (50 MW). End A 19 MW, End B 25 MW. В
- С As of 1526 hours, March 26, 2016, Stephenville Gas Turbine End A unavailable (25 MW).
- D As of 1029 hours, April 15, 2016, Holyrood Unit 3 unavailable (150 MW).
- As of 2209 hours, April 30, 2016, Holyrood Unit 1 derated to 120 MW (170 MW). Ε
- As of 1200 hours, May 07, 2016, Holyrood Unit 2 derated to 120 MW (170 MW).
- As of 0937 hours, May 10, 2016, Bay d'Espoir Unit 6 unavailable (76.5 MW). G
- н As of 0724 hours, May 16 2016, Nalcor Exploits Grand Falls Unit 4 (30 MW) unavailable. Net impact to the Island Interconnected System is 7 MW.
- At 1029 hours, May 19, 2016, Bay d'Espoir Unit 2 unavailable (76.5 MW).
- At 1852 hours, May 19, 2016, Bay d'Espoir Unit 2 available (76.5 MW).
- At 1852 hours, May 19, 2016, Bay d'Espoir Unit 1 available (76.5 MW).
- At 2028 hours, May 19, 2016, Bay d'Espoir Unit 7 unavailable (154.4 MW)

Fri, May 20, 2016 Island System Outlook ³		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast
Available Island System Supply: ⁵	1,465	MW	Friday, May 20, 2016	9	10	860
NLH Generation: ⁴	1,175	MW	Saturday, May 21, 2016	10	12	795
NLH Power Purchases: ⁶	90	MW	Sunday, May 22, 2016	6	5	905
Other Island Generation:	200	MW	Monday, May 23, 2016	8	8	910
Current St. John's Temperature:	8	°C	Tuesday, May 24, 2016	13	15	790
Current St. John's Windchill:	N/A	°C	Wednesday, May 25, 2016	11	16	770
7-Day Island Peak Demand Forecast:	910	MW	Thursday, May 26, 2016	14	13	840
			re included. These are not unusual for powe ses to system equipment whenever possible	• •		

- 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
- 3. As of 0800 Hours.
- 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
- 5. Gross output from all Island sources (including Note 4).
- 6. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Vale capacity assistance (when applicable), and Wind Generation.

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak							
Thu, May 19, 2016	Actual Island Peak Demand ⁸	08:05	941 MW				
ri, May 20, 2016	Forecast Island Peak Demand		860 MW				