


Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Friday, June 10, 2016

Section 1 Island Interconnected System Supply and Demand Actual 24 Hour System Performance For Thursday, June 09, 2016

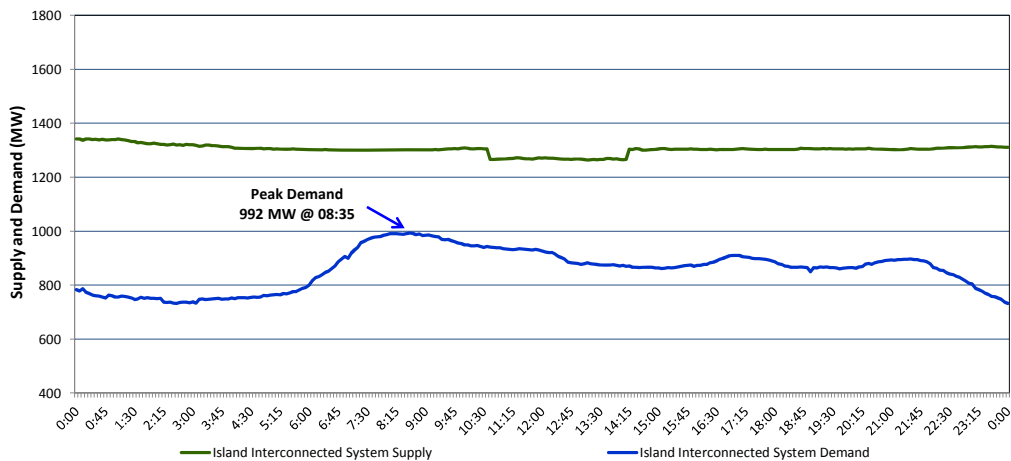

Supply Notes For June 09, 2016

- 1,2
- A As of 1956 hours, January 14, 2016, Nalcor Exploits Grand Falls Unit 7 unavailable. No net impact to the Island Interconnected System.
 - B As of 1526 hours, March 26, 2016, Stephenville Gas Turbine End A unavailable (25 MW).
 - C As of 1029 hours, April 15, 2016, Holyrood Unit 3 unavailable (150 MW).
 - D As of 0937 hours, May 10, 2016, Bay d'Espoir Unit 6 unavailable (76.5 MW).
 - E As of 0919 hours, May 29, 2016, Holyrood Unit 2 derated to 120 MW (170 MW).
 - F As of 0958 hours, May 31, 2016, Holyrood Combustion Turbine unavailable (123.5 MW).
 - G As of 0822 hours, June 05, 2016, Bay d'Espoir Unit 3 unavailable (76.5 MW).
 - H As of 0822 hours, June 05, 2016, Bay d'Espoir Unit 4 unavailable (76.5 MW).
 - I As of 1059 hours, June 05, 2016, Nalcor Exploits Grand Falls Unit 9 (30 MW) unavailable. Net impact to the Island Interconnected System is 7 MW.
 - J As of 2008 hours, June 06, 2016, Stephenville Gas Turbine End B unavailable (25 MW).
 - K As of 2315 hours, June 08, 2016, Holyrood Unit 1 derated to 120 MW (170 MW).
 - L At 1000 hours, June 09, 2016, St. Anthony Diesel Unit 546 unavailable (2 MW).
 - M At 1039 hours, June 09, 2016, Hardwoods Gas Turbine unavailable, previously derated to 38 MW (50 MW). End A 19 MW, End B 25 MW.
 - N At 1411 hours, June 09, 2016, Hardwoods Gas Turbine available, derated to 38 MW (50 MW). End A 19 MW, End B 25 MW.
 - O At 1430 hours, June 09, 2016, St. Anthony Diesel Unit 546 available (2 MW).

Section 2 Island Interconnected Supply and Demand

Fri, Jun 10, 2016			Island System Outlook ³		Seven-Day Forecast		Temperature (°C)		Island System Daily Peak Demand (MW)
							Morning	Evening	Forecast
Available Island System Supply: ⁵	1,310	MW			Friday, June 10, 2016		6	7	940
NLH Generation: ⁴	1,030	MW			Saturday, June 11, 2016		6	8	935
NLH Power Purchases: ⁶	105	MW			Sunday, June 12, 2016		9	13	785
Other Island Generation:	175	MW			Monday, June 13, 2016		11	10	860
Current St. John's Temperature:	6	°C			Tuesday, June 14, 2016		11	9	820
Current St. John's Windchill:	N/A	°C			Wednesday, June 15, 2016		12	11	800
7-Day Island Peak Demand Forecast:	940	MW			Thursday, June 16, 2016		10	9	835

Supply Notes For June 10, 2016

- 3
- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Vale capacity assistance (when applicable), and Wind Generation.

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Thu, Jun 09, 2016	Actual Island Peak Demand ⁸	08:35	992 MW
Fri, Jun 10, 2016	Forecast Island Peak Demand		940 MW

Notes: 8. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).