


Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Tuesday, June 28, 2016

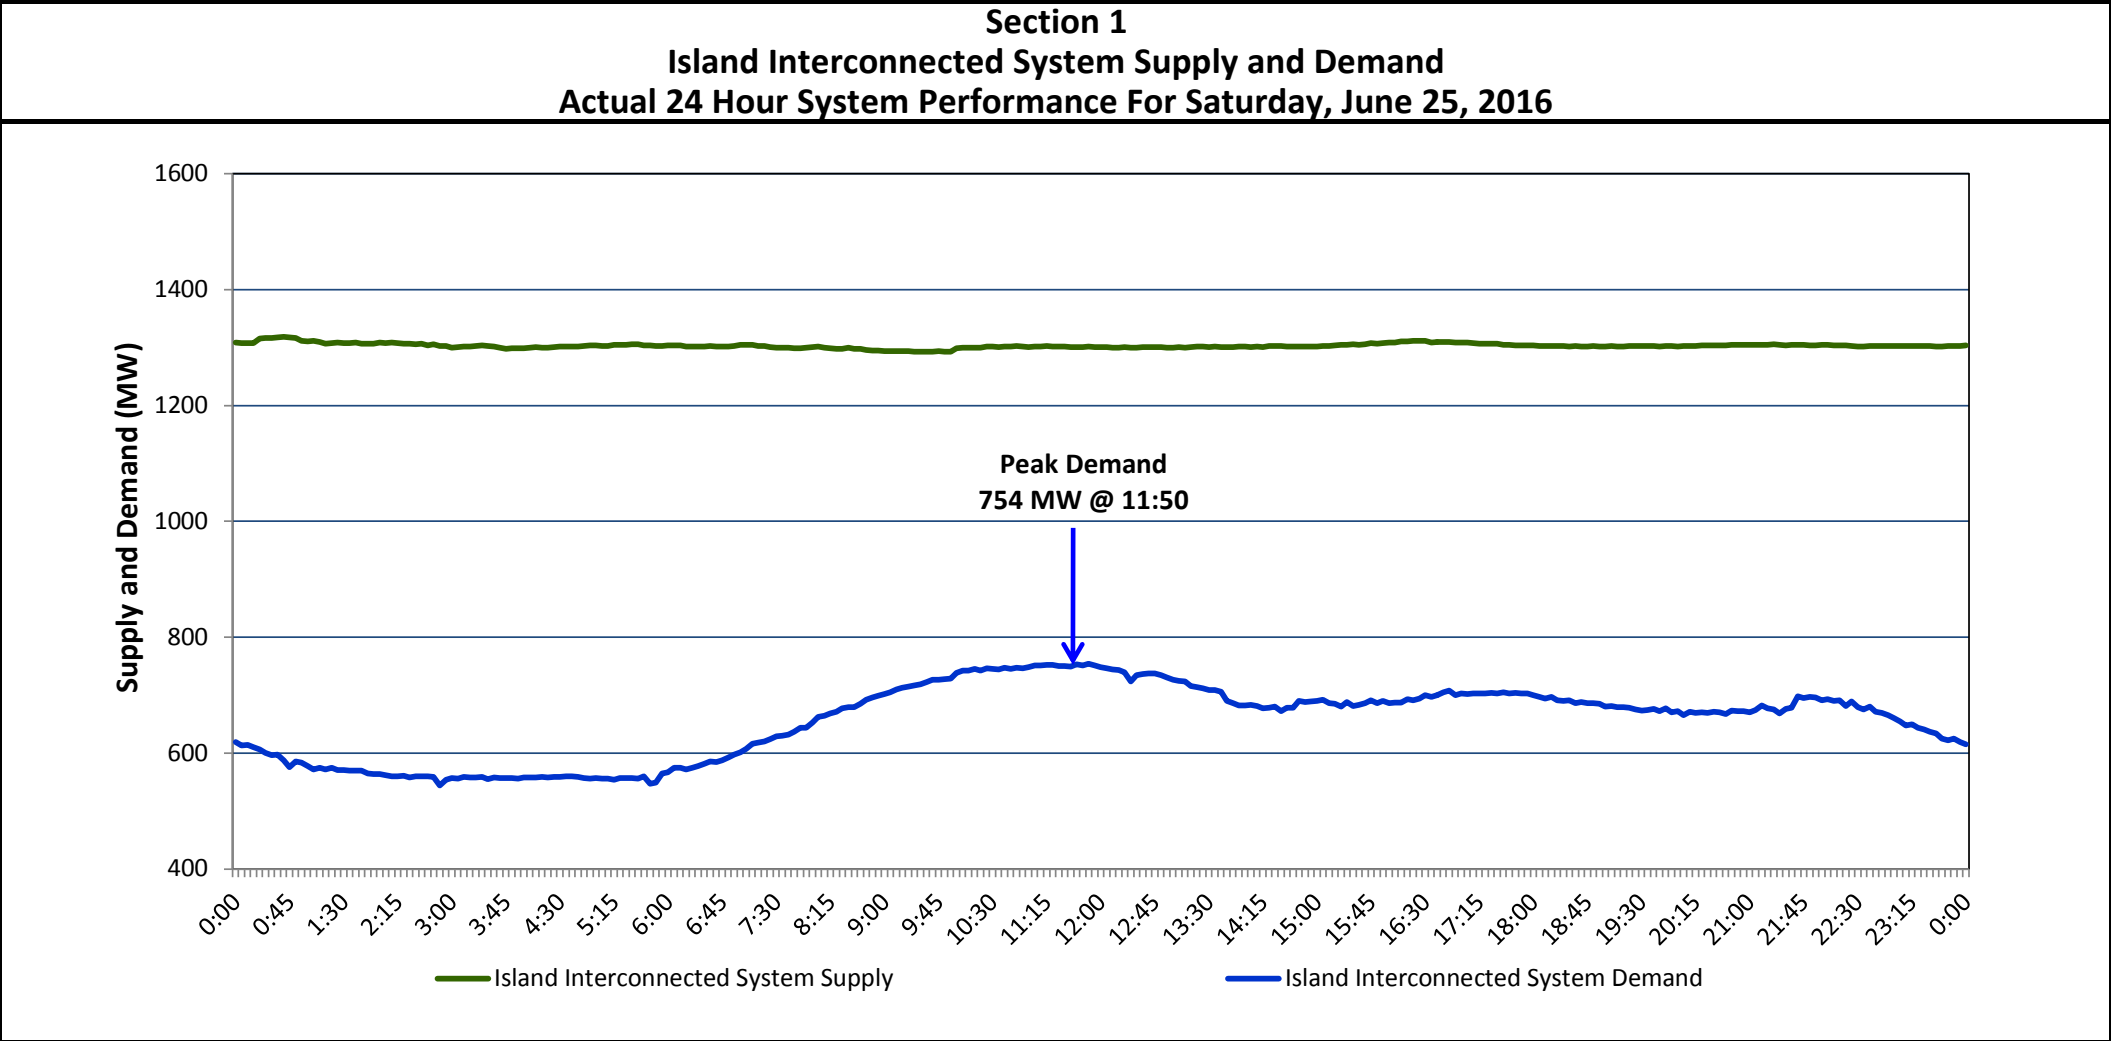

Supply Notes For June 25, 2016

A

As of 1956 hours, January 14, 2016, Nalcor Exploits Grand Falls Unit 7 unavailable. No net impact to the Island Interconnected System.

B

As of 1526 hours, March 26, 2016, Stephenville Gas Turbine End A unavailable (25 MW).

C

As of 1029 hours, April 15, 2016, Holyrood Unit 3 unavailable (150 MW).

D

As of 0937 hours, May 10, 2016, Bay d'Espoir Unit 6 unavailable (76.5 MW).

E

As of 0822 hours, June 05, 2016, Bay d'Espoir Unit 3 unavailable (76.5 MW).

F

As of 0822 hours, June 05, 2016, Bay d'Espoir Unit 4 unavailable (76.5 MW).

G

As of 1059 hours, June 05, 2016, Nalcor Exploits Grand Falls Unit 9 (30 MW) unavailable. Net impact to the Island Interconnected System is 7 MW.

H

As of 2008 hours, June 06, 2016, Stephenville Gas Turbine End B unavailable (25 MW).

I

As of 2315 hours, June 08, 2016, Holyrood Unit 1 derated to 120 MW (170 MW).

J

As of 1411 hours, June 09, 2016, Hardwoods Gas Turbine derated to 38 MW (50 MW). End A 19 MW, End B 25 MW.

K

As of 1425 hours, June 16, 2016, Holyrood Unit 2 unavailable. Previously derated to 120 MW (170 MW).

Section 2  
Island Interconnected Supply and Demand

Sun, Jun 26, 2016		Island System Outlook <sup>3</sup>		Seven-Day Forecast		Temperature (°C)		Island System Daily Peak Demand (MW)
						Morning	Evening	Forecast
Available Island System Supply: <sup>5</sup>		1,325	MW	Sunday, June 26, 2016		22	10	740
NLH Generation: <sup>4</sup>		1,030	MW	Monday, June 27, 2016		22	15	790
NLH Power Purchases: <sup>6</sup>		95	MW	Tuesday, June 28, 2016		22	18	745
Other Island Generation:		200	MW	Wednesday, June 29, 2016		24	14	n/a - see * note below
Current St. John's Temperature:		18	°C	Thursday, June 30, 2016		23	13	n/a - see * note below
Current St. John's Windchill:		N/A	°C	Friday, July 01, 2016		24	12	n/a - see * note below
7-Day Island Peak Demand Forecast:		790	MW	Saturday, July 02, 2016		14	12	n/a - see * note below

Supply Notes For June 26, 2016

Notes: 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.  
2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.  
3. As of 0800 Hours.  
4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).  
5. Gross output from all Island sources (including Note 4).  
6. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Vale capacity assistance (when applicable), and Wind Generation.

Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak

Sat, Jun 25, 2016	Actual Island Peak Demand <sup>8</sup>	11:50	754 MW
Sun, Jun 26, 2016	Forecast Island Peak Demand		740 MW

Notes: 8. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).

\* Load forecast data for these days are unavailable due to an issue with Hydro's load forecasting application. These issues have since been corrected.