


## Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Monday, December 04, 2017

### Section 1 Island Interconnected System Supply and Demand Actual 24 Hour System Performance For Sunday, December 03, 2017

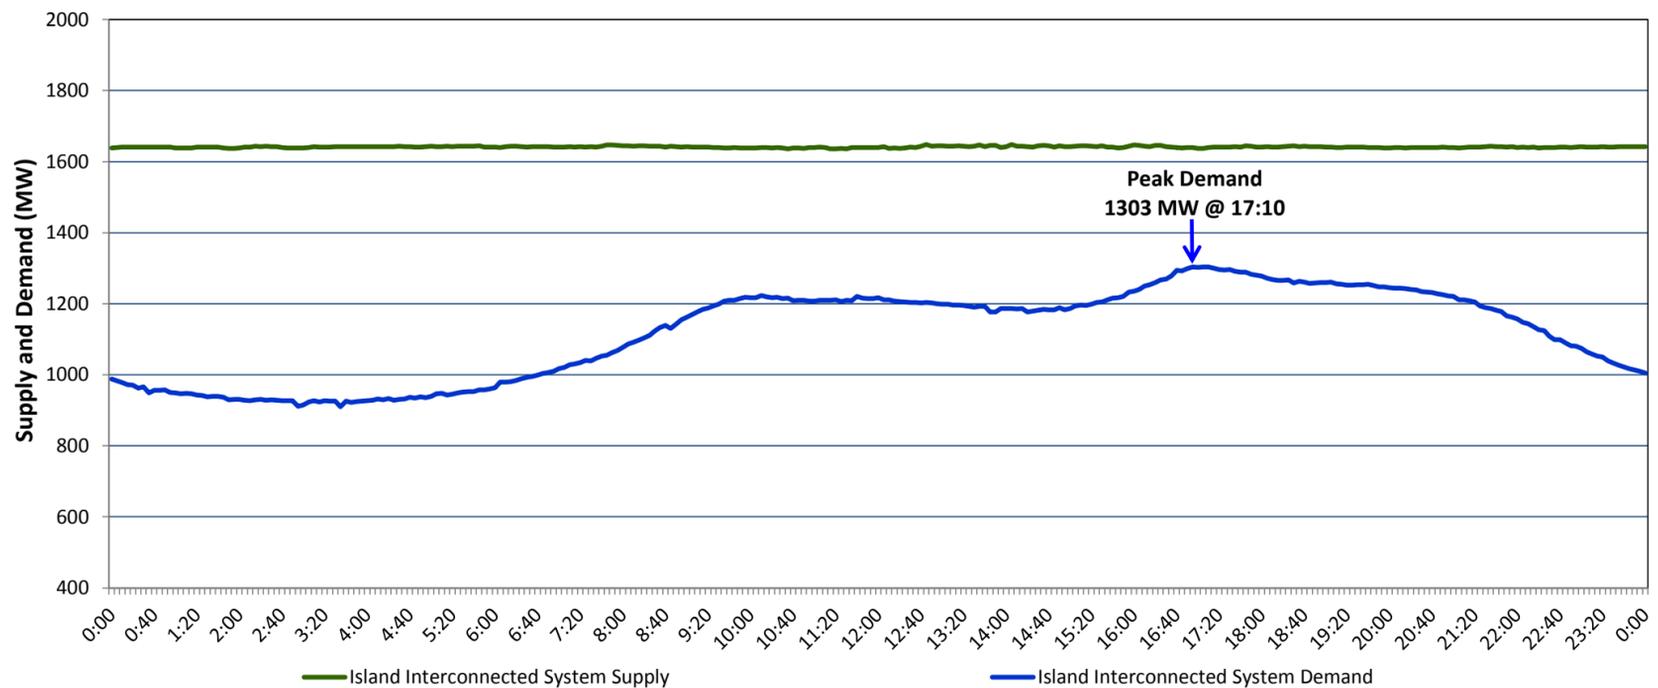

#### Supply Notes For December 03, 2017

- 1,2
- A As of 1510 hours, November 04, 2017, Bay d'Espoir Unit 1 unavailable (76.5 MW).
  - B As of 1510 hours, November 04, 2017, Bay d'Espoir Unit 2 unavailable (76.5 MW).
  - C As of 1908 hours, November 24, 2017, Holyrood Unit 2 available at 160 MW (170 MW).
  - D As of 2148 hours, November 30, 2017, Holyrood Unit 1 unavailable due to planned outage 145 MW (170 MW).
  - E As of 0852 hours, December 02, 2017, Stephenville Gas Turbine available at 38 MW (50 MW).

### Section 2 Island Interconnected Supply and Demand

Mon, Dec 04, 2017	Island System Outlook <sup>3</sup>	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	1,620 MW	Monday, December 04, 2017	1	1	1,400	1,293
NLH Generation: <sup>4</sup>	1,350 MW	Tuesday, December 05, 2017	0	0	1,420	1,312
NLH Power Purchases: <sup>6</sup>	80 MW	Wednesday, December 06, 2017	0	2	1,305	1,199
Other Island Generation:	190 MW	Thursday, December 07, 2017	3	5	1,290	1,184
Current St. John's Temperature:	1 °C	Friday, December 08, 2017	2	0	1,330	1,223
Current St. John's Windchill:	N/A °C	Saturday, December 09, 2017	1	6	1,350	1,243
7-Day Island Peak Demand Forecast:	1,420 MW	Sunday, December 10, 2017	5	6	1,295	1,189

#### Supply Notes For December 04, 2017

- 3
- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Vale capacity assistance (when applicable), and Wind Generation.
  7. Adjusted for CBP&P and Vale and Praxair interruptible load and the impact of voltage reduction, when applicable.

### Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Sun, Dec 03, 2017	Actual Island Peak Demand <sup>8</sup>	17:10	1,303 MW
Mon, Dec 04, 2017	Forecast Island Peak Demand		1,400 MW

- Notes: 8. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).