


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Thursday, April 05, 2018**

**Section 1  
Island Interconnected System Supply, Demand & Exports  
Actual 24 Hour System Performance For Wednesday, April 04, 2018**

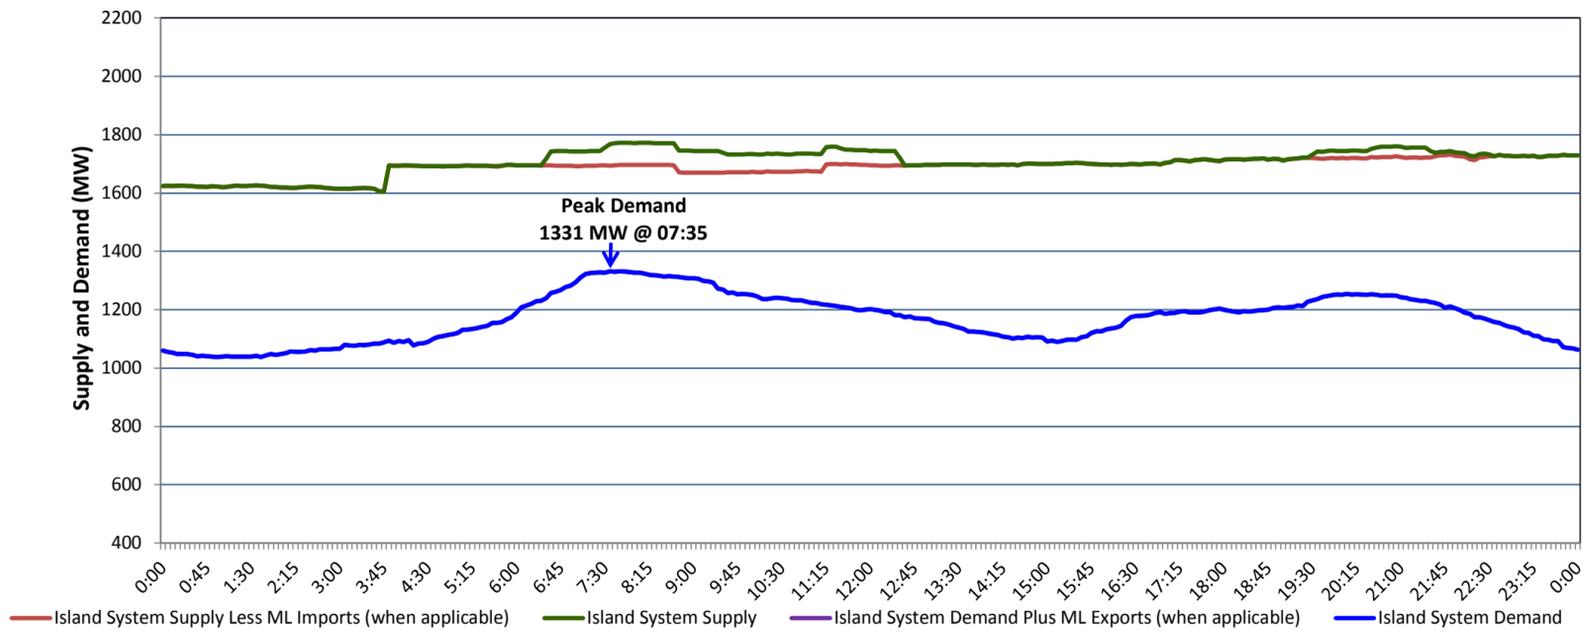

**Supply Notes For April 04, 2018**

1,2

- A As of 2115 hours, January 04, 2018, Stephenville Gas Turbine available at 25 MW (50 MW).
- B As of 0325 hours, March 27, 2018, Holyrood Unit 1 available at 137 MW (170 MW).
- C As of 0801 hours, April 02, 2018, Holyrood Unit 3 unavailable due to planned outage 110 MW (150 MW).
- D As of 1603 hours, April 02, 2018, Paradise River Unit unavailable due to planned outage (8 MW).
- E At 0346 hours, April 04, 2018, Holyrood Unit 2 available at 80 MW (170 MW).
- F At 0845 hours, April 04, 2018, Hardwoods Gas Turbine available at 25 MW due to planned outage (50 MW).
- G At 1113 hours, April 04, 2018, Hardwoods Gas Turbine available at full capacity (50 MW).

**Section 2  
Island Interconnected Supply and Demand**

Thu, Apr 05, 2018	Island System Outlook <sup>3</sup>	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	1,610 MW	Thursday, April 05, 2018	7	2	1,230	1,150
NLH Generation: <sup>4</sup>	1,305 MW	Friday, April 06, 2018	-1	-4	1,340	1,260
NLH Power Purchases: <sup>6</sup>	100 MW	Saturday, April 07, 2018	-2	4	1,300	1,220
Maritime Link Imports:	- MW	Sunday, April 08, 2018	0	4	1,245	1,165
Other Island Generation:	205 MW	Monday, April 09, 2018	2	-1	1,280	1,200
Current St. John's Temperature & Windchill:	0 °C -7 °C	Tuesday, April 10, 2018	-2	-2	1,315	1,235
7-Day Island Peak Demand Forecast:	1,340 MW	Wednesday, April 11, 2018	0	4	1,305	1,225

**Supply Notes For April 05, 2018**

3

- H At 0216 hours, April 05, 2018, Holyrood Unit 2 unavailable due to planned outage 80 MW (170 MW).

- Notes:
- Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  - Due to the Island System having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
  - As of 0800 Hours.
  - Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  - Gross output from all Island sources (including Note 4).
  - NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation, Vale capacity assistance (when applicable).
  - Adjusted for CBP&P and Maritime Link Exports.

**Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak**

Wed, Apr 04, 2018	Actual Island Peak Demand <sup>8</sup>	07:35	1,331 MW
Thu, Apr 05, 2018	Forecast Island Peak Demand		1,230 MW

- Notes: 8. Island Demand / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).