


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Tuesday, March 19, 2019**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Monday, March 18, 2019**

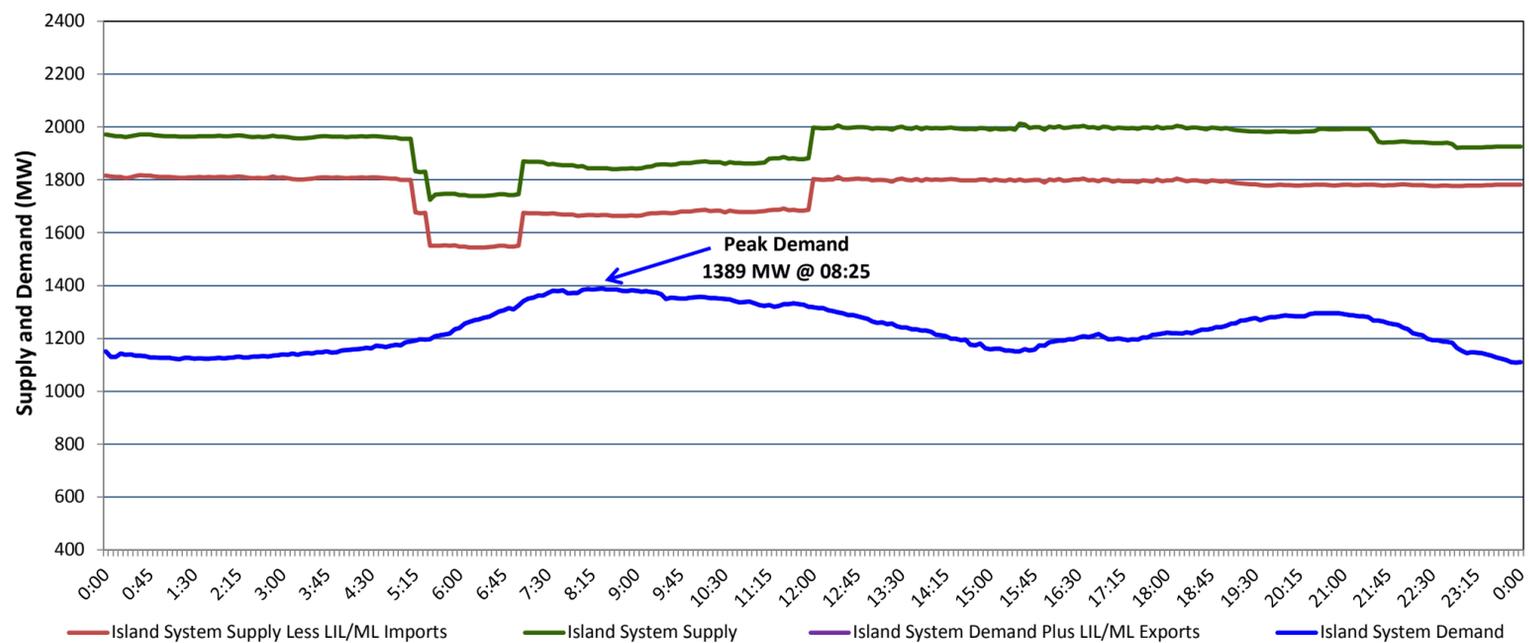

Supply Notes For March 18, 2019

- A As of 0721 hours, March 06, 2019, Hardwoods Gas Turbine available at 25 MW (50 MW).
- B As of 0045 hours, March 09, 2019, Holyrood Unit 3 removed from service for economic dispatch (150 MW).
- C As of 1159 hours, March 17, 2019, Bay d'Espoir Unit 6 unavailable due to planned outage (76.5 MW).
- D At 0515 hours, March 18, 2019, Holyrood Unit 2 available at 50 MW (170 MW).
- E At 0528 hours, March 18, 2019, Holyrood Gas Turbine unavailable (123.5 MW).
- F At 0705 hours, March 18, 2019, Holyrood Gas Turbine available (123.5 MW).
- G At 1200 hours, March 18, 2019, Holyrood Unit 2 available at full capacity (170 MW).

**Section 2
Island Interconnected Supply and Demand**

Tue, Mar 19, 2019	Island System Outlook ³		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,922	MW	Tuesday, March 19, 2019	-5	-4	1,470	1,367
NLH Island Generation: ⁴	1,440	MW	Wednesday, March 20, 2019	-5	-4	1,485	1,382
NLH Island Power Purchases: ⁶	135	MW	Thursday, March 21, 2019	-3	-3	1,415	1,313
Other Island Generation:	200	MW	Friday, March 22, 2019	-2	1	1,330	1,229
ML/LIL Imports:	147	MW	Saturday, March 23, 2019	1	1	1,225	1,125
Current St. John's Temperature & Windchill:	-6 °C	-12 °C	Sunday, March 24, 2019	1	1	1,250	1,150
7-Day Island Peak Demand Forecast:	1,485	MW	Monday, March 25, 2019	-3	-6	1,450	1,347

Supply Notes For March 19, 2019

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Mon, Mar 18, 2019	Actual Island Peak Demand ⁸	08:25	1,389 MW
Tue, Mar 19, 2019	Forecast Island Peak Demand		1,470 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).