


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Friday, April 05, 2019**

**Section 1  
Island Interconnected System Supply, Demand & Exports  
Actual 24 Hour System Performance For Thursday, April 04, 2019**

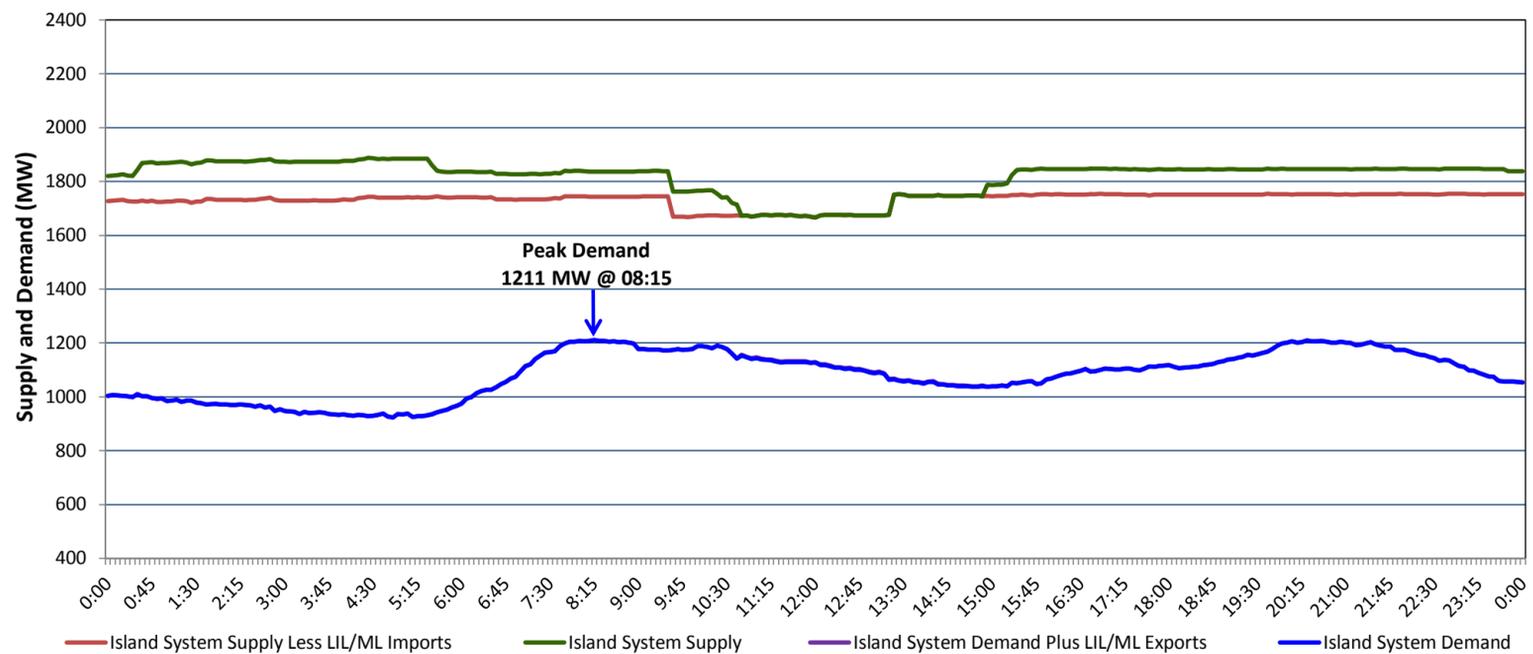

**Supply Notes For April 04, 2019**

1,2

- A As of 1159 hours, March 17, 2019, Bay d'Espoir Unit 6 unavailable due to planned outage (76.5 MW).
- B As of 1049 hours, March 22, 2019, Bay d'Espoir Unit 5 unavailable due to planned outage (76.5 MW).
- C As of 0000 hours, April 01, 2019, Holyrood Unit 3 unavailable due to planned outage (150 MW).
- D As of 1038 hours, April 01, 2019, Hardwoods Gas Turbine available at 25 MW (50 MW).
- E **At 0935 hours, April 04, 2019, Bay d'Espoir Unit 4 unavailable (76.5 MW).**
- F **At 1318 hours, April 04, 2019, Bay d'Espoir Unit 4 available (76.5 MW).**

**Section 2  
Island Interconnected Supply and Demand**

Fri, Apr 05, 2019	Island System Outlook <sup>3</sup>	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	1,849 MW	Friday, April 05, 2019	-2	-2	1,365	1,285
NLH Island Generation: <sup>4</sup>	1,365 MW	Saturday, April 06, 2019	-3	0	1,275	1,195
NLH Island Power Purchases: <sup>6</sup>	170 MW	Sunday, April 07, 2019	1	1	1,195	1,115
Other Island Generation:	220 MW	Monday, April 08, 2019	-5	-3	1,485	1,405
ML/LIL Imports:	94 MW	Tuesday, April 09, 2019	-3	-1	1,365	1,285
Current St. John's Temperature & Windchill:	-3 °C	Wednesday, April 10, 2019	-2	-1	1,335	1,255
7-Day Island Peak Demand Forecast:	1,485 MW	Thursday, April 11, 2019	0	2	1,275	1,195

**Supply Notes For April 05, 2019**

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak**

Thu, Apr 04, 2019	Actual Island Peak Demand <sup>8</sup>	08:15	1,211 MW
Fri, Apr 05, 2019	Forecast Island Peak Demand		1,365 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).