


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Tuesday, May 21, 2019**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Saturday, May 18, 2019**

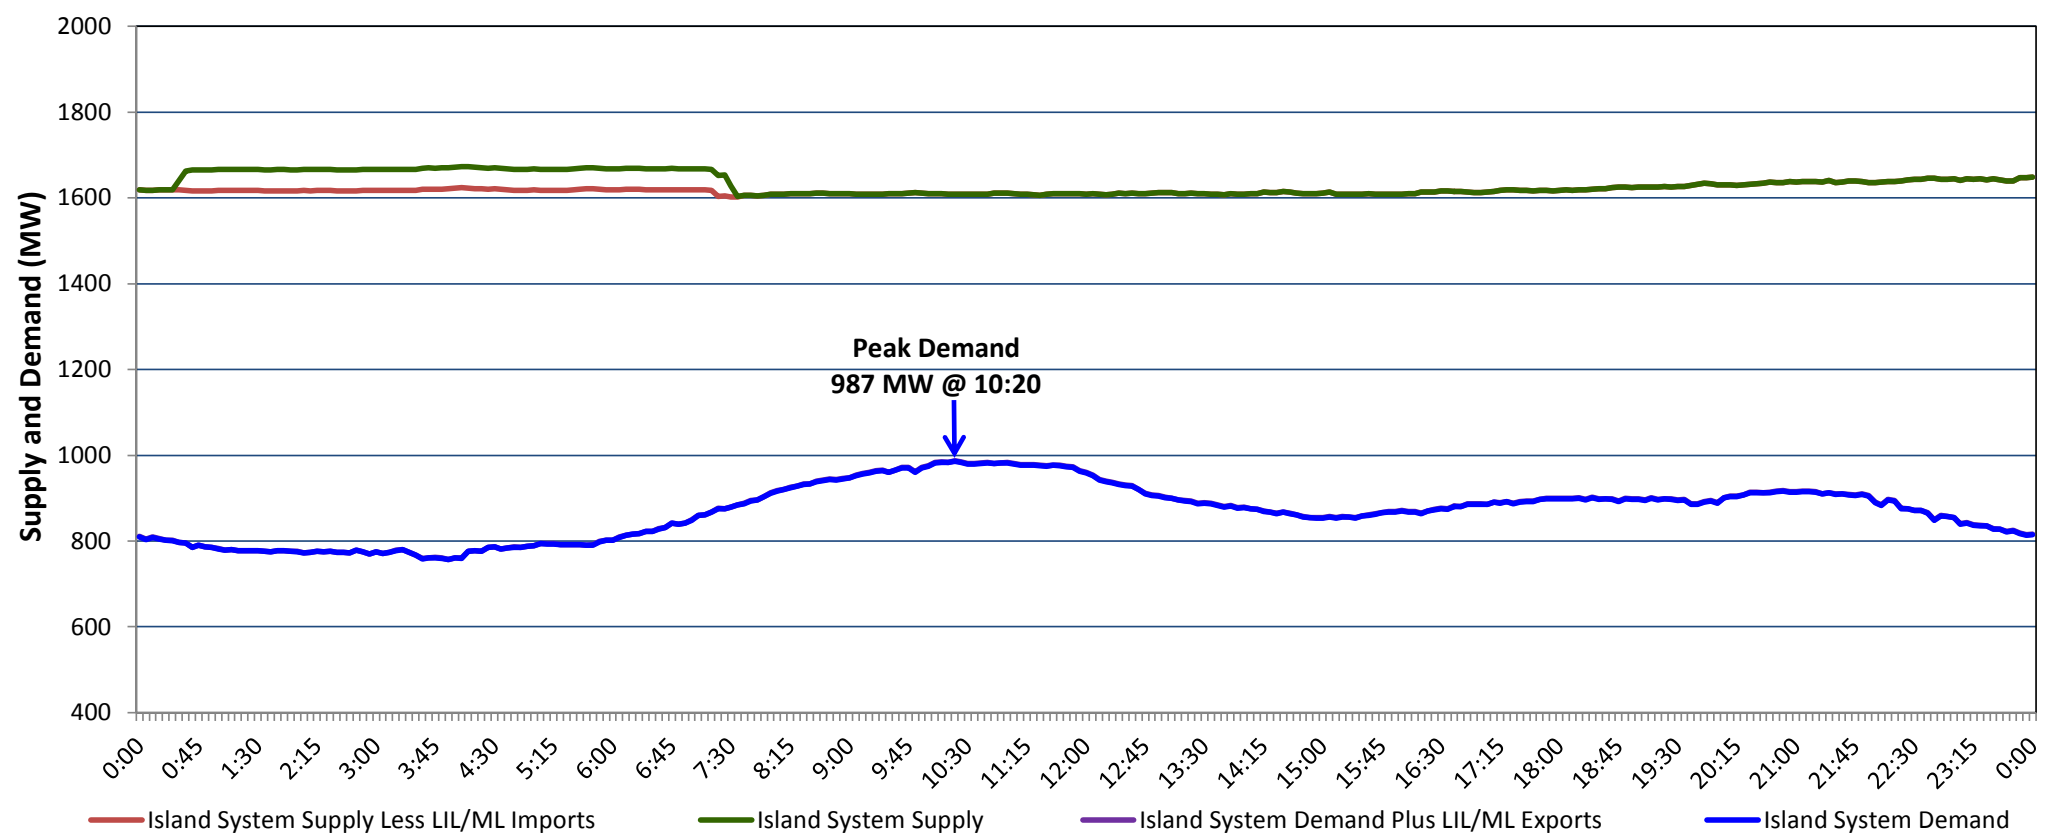

Supply Notes For May 18, 2019

1,2

- A** As of 0000 hours, April 01, 2019, Holyrood Unit 3 unavailable due to planned outage (150 MW).
- B** As of 1833 hours, April 27, 2019, Hardwoods Gas Turbine available at 25 MW (50 MW).
- C** As of 1430 hours, May 05, 2019, Bay d'Espoir Unit 4 unavailable due to planned outage (76.5 MW).
- D** As of 0729 hours, May 12, 2019, St. Anthony Diesel Plant available at 8.85 MW (9.7 MW).
- E** As of 1000 hours, May 16, 2019, Holyrood Unit 2 removed from service for economic dispatch (170 MW).

**Section 2
Island Interconnected Supply and Demand**

| Sun, May 19, 2019 | Island System Outlook ³ | | Seven-Day Forecast | Temperature (°C) | | Island System Daily Peak Demand (MW) | |
|--|------------------------------------|--------|-------------------------|------------------|---------|--------------------------------------|-----------------------|
| | | | | Morning | Evening | Forecast | Adjusted ⁷ |
| Available Island System Supply: ⁵ | 1,625 | MW | Sunday, May 19, 2019 | 2 | 2 | 1,115 | 1,115 |
| NLH Island Generation: ⁴ | 1,270 | MW | Monday, May 20, 2019 | 2 | 4 | 1,095 | 1,095 |
| NLH Island Power Purchases: ⁶ | 140 | MW | Tuesday, May 21, 2019 | 2 | 3 | 1,065 | 1,065 |
| Other Island Generation: | 215 | MW | Wednesday, May 22, 2019 | 3 | 3 | 1,115 | 1,115 |
| ML/LIL Imports: | - | MW | Thursday, May 23, 2019 | 2 | 4 | 1,160 | 1,160 |
| Current St. John's Temperature & Windchill: | 2 °C | N/A °C | Friday, May 24, 2019 | 4 | 3 | 1,115 | 1,115 |
| 7-Day Island Peak Demand Forecast: | 1,160 | MW | Saturday, May 25, 2019 | 7 | 10 | 860 | 860 |

Supply Notes For May 19, 2019

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

| | | | |
|-------------------|--|-------|----------|
| Sat, May 18, 2019 | Actual Island Peak Demand ⁸ | 10:20 | 987 MW |
| Sun, May 19, 2019 | Forecast Island Peak Demand | | 1,115 MW |

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).