


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Thursday, December 05, 2019**

**Section 1  
Island Interconnected System Supply, Demand & Exports  
Actual 24 Hour System Performance For Wednesday, December 04, 2019**

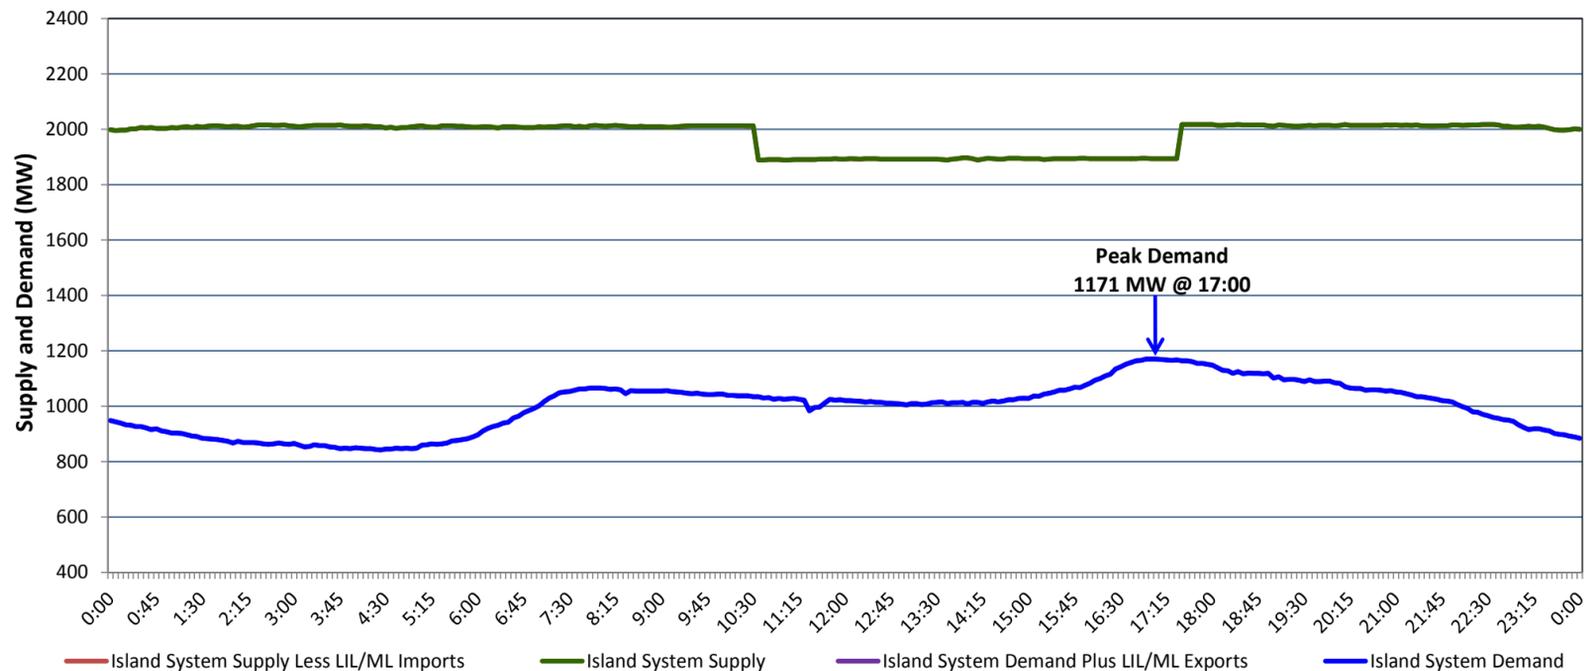

**Supply Notes For December 04, 2019**

- A As of 0932 hours, November 23, 2019, St. Anthony Diesel Plant available at 8.85 MW (9.7 MW).
- B As of 1600 hours, November 28, 2019, Stephenville Gas Turbine available at 25 MW (50 MW).
- C At 1033 hours, December 04, 2019, Holyrood Gas Turbine unavailable due to planned outage (123.5 MW).
- D At 1728 hours, December 04, 2019, Holyrood Gas Turbine available (123.5 MW).

**Section 2  
Island Interconnected Supply and Demand**

Thu, Dec 05, 2019	Island System Outlook <sup>3</sup>	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	1,885 MW	Thursday, December 05, 2019	2	1	1,235	1,133
NLH Island Generation: <sup>4</sup>	1,545 MW	Friday, December 06, 2019	1	0	1,290	1,187
NLH Island Power Purchases: <sup>6</sup>	145 MW	Saturday, December 07, 2019	0	2	1,300	1,197
Other Island Generation:	195 MW	Sunday, December 08, 2019	-3	-3	1,385	1,281
ML/LIL Imports:	- MW	Monday, December 09, 2019	-3	2	1,355	1,251
Current St. John's Temperature & Windchill: 2 °C	N/A °C	Tuesday, December 10, 2019	5	7	1,260	1,157
7-Day Island Peak Demand Forecast:	1,385 MW	Wednesday, December 11, 2019	14	5	1,195	1,093

**Supply Notes For December 05, 2019**

- E At 0739 hours, December 05, 2019, Holyrood Gas Turbine unavailable due to planned outage (123.5 MW).

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak**

Wed, Dec 04, 2019	Actual Island Peak Demand <sup>8</sup>	17:00	1,171 MW
Thu, Dec 05, 2019	Forecast Island Peak Demand		1,235 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).