


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Monday, March 09, 2020**

**Section 1  
Island Interconnected System Supply, Demand & Exports  
Actual 24 Hour System Performance For Sunday, March 08, 2020**

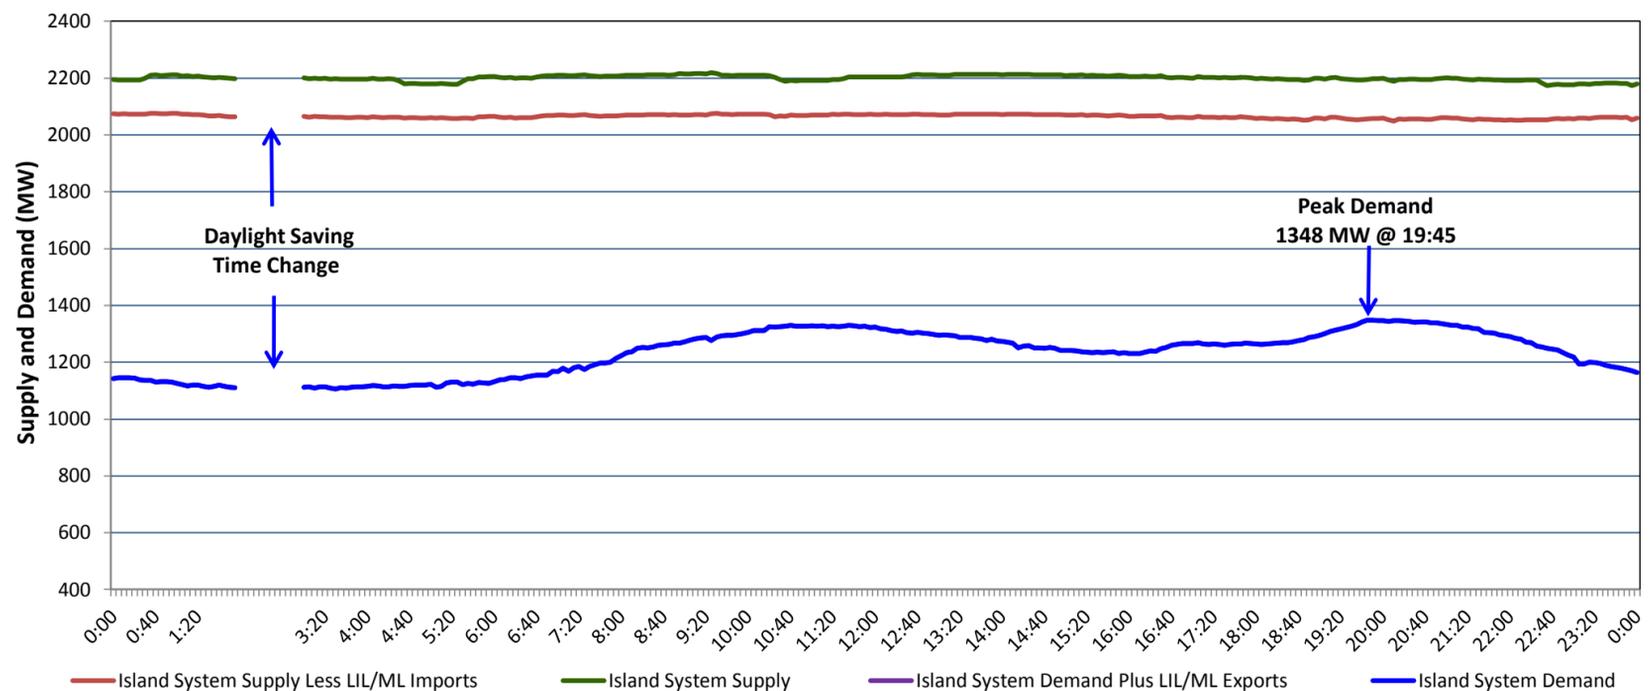

**Supply Notes For March 08, 2020**

1,2

A As of 0658 hours, February 28, 2020, Holyrood Diesels available at 8 MW (10 MW).

**Section 2  
Island Interconnected Supply and Demand**

Mon, Mar 09, 2020	Island System Outlook <sup>3</sup>			Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
					Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	2,118	MW		Monday, March 09, 2020	-5	-11	1,590	1,484
NLH Island Generation: <sup>4</sup>	1,690	MW		Tuesday, March 10, 2020	-13	-8	1,670	1,563
NLH Island Power Purchases: <sup>6</sup>	145	MW		Wednesday, March 11, 2020	-3	2	1,430	1,325
Other Island Generation:	230	MW		Thursday, March 12, 2020	-1	-1	1,325	1,222
ML/LIL Imports:	53	MW		Friday, March 13, 2020	-6	-3	1,465	1,360
Current St. John's Temperature & Windchill:	-6 °C	-13 °C		Saturday, March 14, 2020	-1	1	1,320	1,217
7-Day Island Peak Demand Forecast:	1,670	MW		Sunday, March 15, 2020	-3	-4	1,375	1,271

**Supply Notes For March 09, 2020**

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak**

Sun, Mar 08, 2020	Actual Island Peak Demand <sup>8</sup>	19:45	1,348 MW
Mon, Mar 09, 2020	Forecast Island Peak Demand		1,590 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).