


Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Friday, January 08, 2021

Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Thursday, January 07, 2021

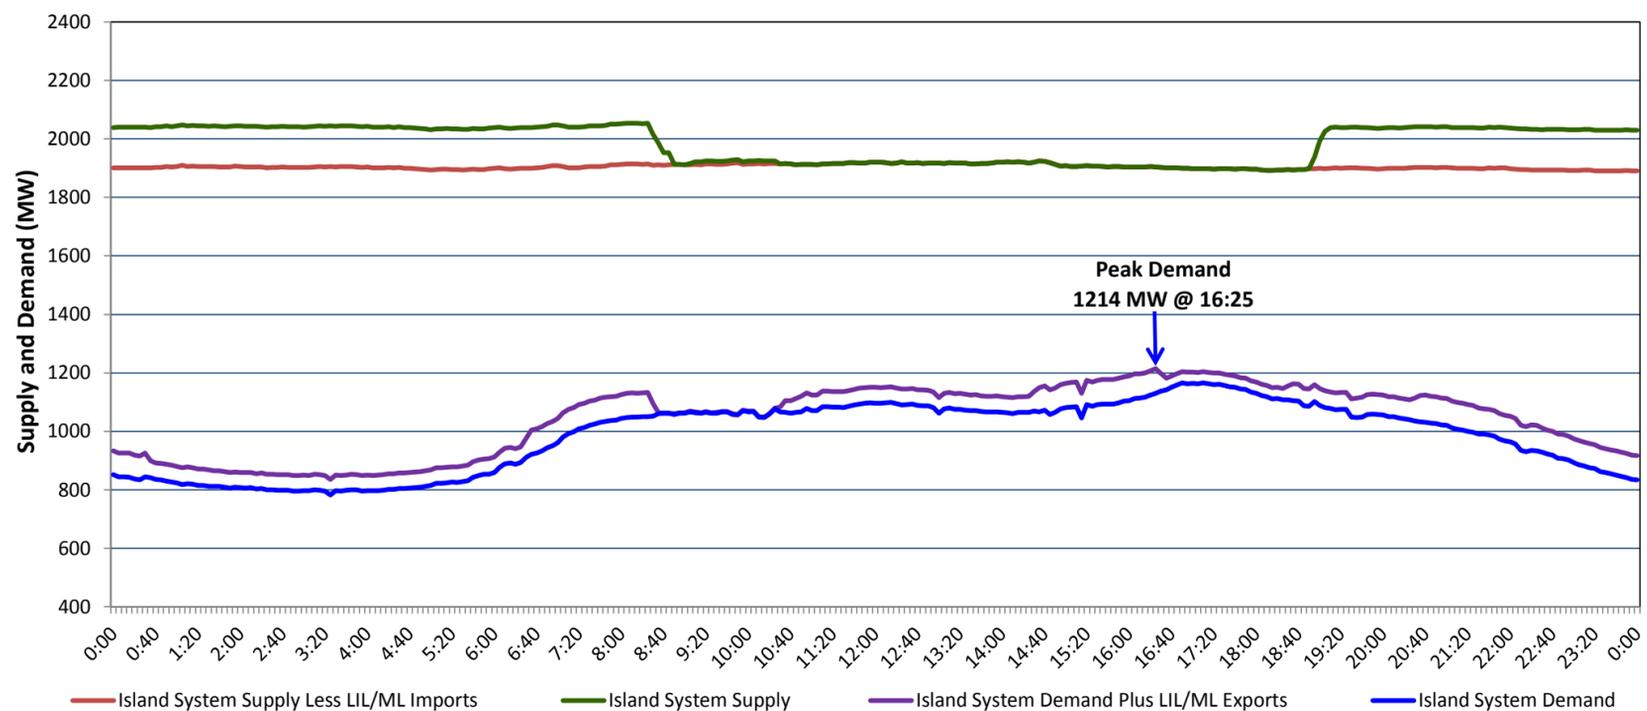

Supply Notes For January 07, 2021

1,2

- A As of 1903 hours, December 18, 2020, Hawkes Bay Diesel Plant available at 2.5 MW (5 MW).
 B As of 1433 hours, January 05, 2020, Holyrood Unit 3 available but not operating (150 MW).

Section 2 Island Interconnected Supply and Demand

Fri, Jan 08, 2021	Island System Outlook ³		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	2,054	MW	Friday, January 08, 2021	5	2	1,185	1,083
NLH Island Generation: ⁴	1,540	MW	Saturday, January 09, 2021	3	0	1,235	1,133
NLH Island Power Purchases: ⁶	130	MW	Sunday, January 10, 2021	-1	0	1,345	1,241
Other Island Generation:	245	MW	Monday, January 11, 2021	-2	-4	1,390	1,286
ML/LIL Imports:	139	MW	Tuesday, January 12, 2021	-4	-4	1,405	1,301
Current St. John's Temperature & Windchill:	4 °C	N/A °C	Wednesday, January 13, 2021	-4	-3	1,365	1,261
7-Day Island Peak Demand Forecast:	1,405	MW	Thursday, January 14, 2021	-3	2	1,370	1,266

Supply Notes For January 08, 2021

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Thu, Jan 07, 2021	Actual Island Peak Demand ⁸	16:25	1,214 MW
Fri, Jan 08, 2021	Forecast Island Peak Demand		1,185 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).