


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Monday, July 05, 2021**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Saturday, July 03, 2021**

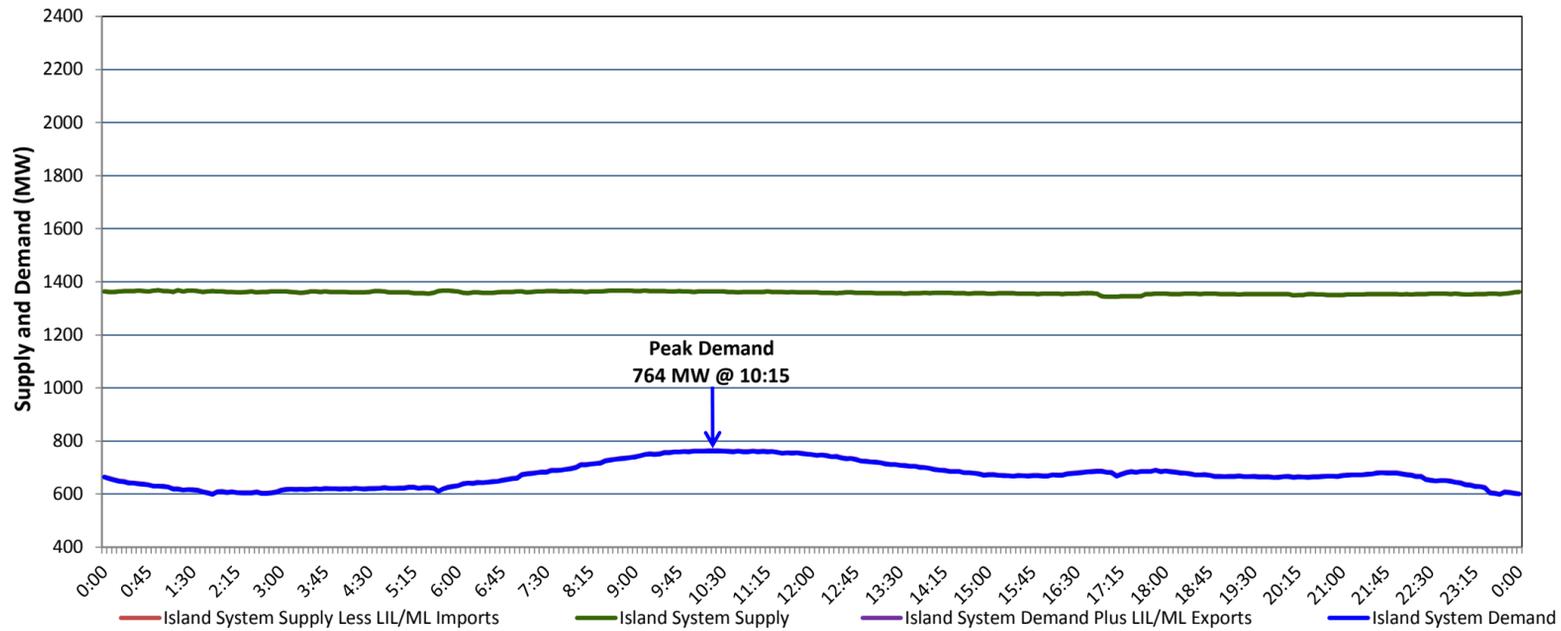

Supply Notes For July 03, 2021

1,2

- A As of 0805 hours, April 09, 2021, Holyrood Unit 3 unavailable due to planned outage (150 MW).
- B As of 0804 hours, May 26, 2021, Holyrood Unit 1 unavailable due to planned outage (170 MW).
- C As of 0720 hours, June 26, 2021, Holyrood Unit 2 available but not operating (170 MW).
- D As of 1020 hours, June 28, 2021, Bay d'Espoir Unit 7 unavailable due to planned outage (154.4 MW).
- E At 1656 hours, July 03, 2021, St. Anthony Diesel Plant unavailable (9.7 MW).
- F At 1740 hours, July 03, 2021, St. Anthony Diesel Plant available (9.7 MW).
- G At 1751 hours, July 03, 2021, St. Anthony Diesel Plant unavailable (9.7 MW).
- H At 1754 hours, July 03, 2021, St. Anthony Diesel Plant available (9.7 MW).

**Section 2
Island Interconnected Supply and Demand**

Sun, Jul 04, 2021	Island System Outlook ³			Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
					Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,400	MW		Sunday, July 04, 2021	9	8	845	845
NLH Island Generation: ⁴	1,050	MW		Monday, July 05, 2021	11	13	810	810
NLH Island Power Purchases: ⁶	125	MW		Tuesday, July 06, 2021	12	17	745	745
Other Island Generation:	225	MW		Wednesday, July 07, 2021	16	16	740	740
ML/LIL Imports:	-	MW		Thursday, July 08, 2021	12	12	775	775
Current St. John's Temperature & Windchill:	9 °C	N/A	°C	Friday, July 09, 2021	12	13	740	740
7-Day Island Peak Demand Forecast:	845	MW		Saturday, July 10, 2021	18	13	730	730

Supply Notes For July 04, 2021

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Sat, Jul 03, 2021	Actual Island Peak Demand ⁸	10:15	764 MW
Sun, Jul 04, 2021	Forecast Island Peak Demand		845 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).