


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Thursday, October 06, 2022**

**Section 1  
Island Interconnected System Supply, Demand & Exports  
Actual 24 Hour System Performance For Wednesday, October 05, 2022**

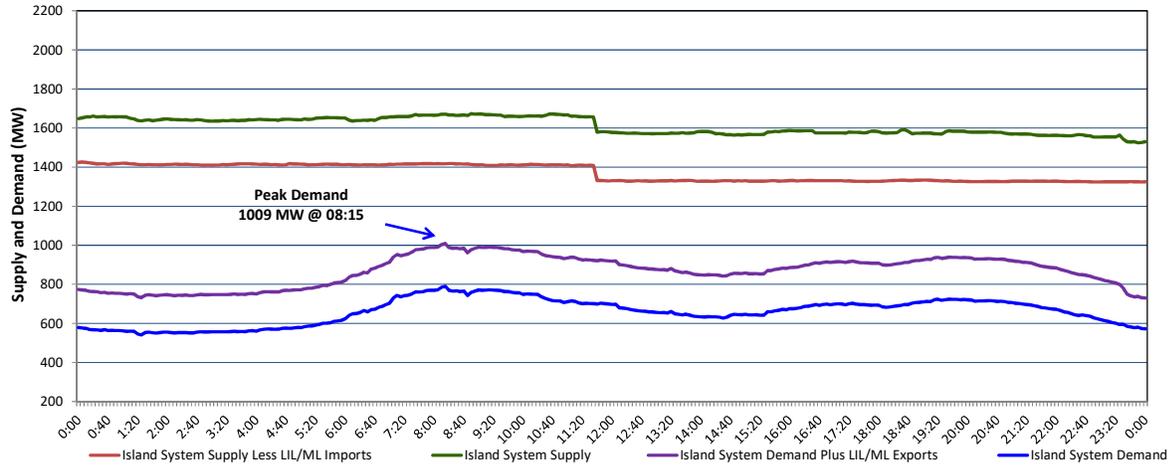

**Supply Notes For October 05, 2022**

- A As of 0800 hours, July 31, 2022, Holyrood Unit 2 unavailable due to planned outage 150 MW (170 MW).
- B As of 1040 hours, August 27, 2022, Holyrood Unit 3 available but not operating (150 MW).
- C As of 1304 hours, September 26, 2022, Hinds Lake Unit available at 65 MW (75 MW).
- D As of 1033 hours, September 27, 2022, Stephenville Gas Turbine unavailable (50 MW).
- E As of 1633 hours, September 29, 2022, Holyrood Unit 1 available but not operating 90 MW (170 MW).
- F As of 0855 hours, October 04, 2022, Upper Salmon Unit unavailable due to planned outage (84 MW).
- G At 1135 hours, October 05, 2022, Bay d'Espoir Unit 3 unavailable due to planned outage (76.5 MW).

**Section 2  
Island Interconnected Supply and Demand**

Thu, Oct 06, 2022	Island System Outlook <sup>3</sup>		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	1,528	MW	Thursday, October 6, 2022	10	12	1,020	1,020
NLH Island Generation: <sup>4,8</sup>	980	MW	Friday, October 7, 2022	12	10	750	750
NLH Island Power Purchases: <sup>6</sup>	90	MW	Saturday, October 8, 2022	11	12	770	770
Other Island Generation:	215	MW	Sunday, October 9, 2022	10	9	795	795
ML/LIL Imports:	243	MW	Monday, October 10, 2022	8	8	865	865
Current St. John's Temperature & Windchill:	9	N/A	Tuesday, October 11, 2022	6	7	895	895
7-Day Island Peak Demand Forecast:	1,020	MW	Wednesday, October 12, 2022	9	9	830	830

**Supply Notes For October 06, 2022**

- Notes:
- Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  - Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
  - As of 0800 Hours.
  - Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  - Gross output from all Island sources (including Note 4).
  - NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  - Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.
  - Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine.

**Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak**

Wed, Oct 05, 2022	Actual Island Peak Demand <sup>9</sup>	8:15	1,009 MW
Thu, Oct 06, 2022	Forecast Island Peak Demand		1,020 MW

Notes: 9. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).