


## Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Monday, November 07, 2022

### Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Sunday, November 06, 2022

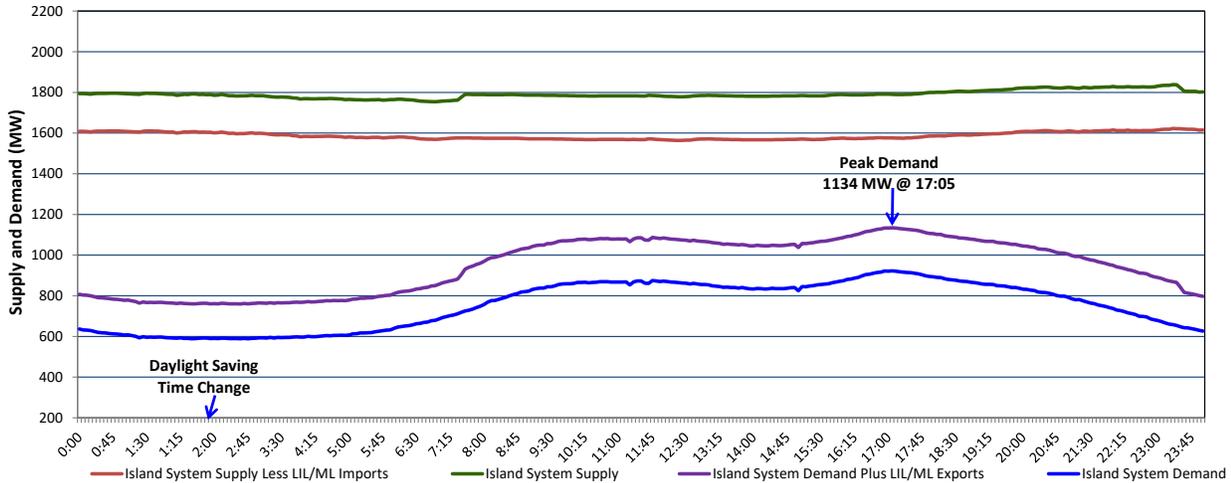

#### Supply Notes For November 06, 2022

1,2

- A As of 1040 hours, August 27, 2022, Holyrood Unit 3 available but not operating (150 MW).
- B As of 1628 hours, October 10, 2022, Bay d'Espoir Unit 4 unavailable due to planned outage (76.5 MW).
- C As of 1423 hours, October 21, 2022, Holyrood Unit 1 available but not operating (170 MW).
- D As of 1630 hours, October 30, 2022, Holyrood Unit 2 available at 150 MW (170 MW).
- E As of 1036 hours, November 03, 2022, Hawkes Bay Diesel Plant available at 2.5 MW (5 MW).

### Section 2 Island Interconnected Supply and Demand

Mon, Nov 07, 2022	Island System Outlook <sup>3</sup>			Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
					Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	1,846	MW		Monday, November 7, 2022	14	14	1,085	992
NLH Island Generation: <sup>4,8</sup>	1,275	MW		Tuesday, November 8, 2022	8	4	1,080	988
NLH Island Power Purchases: <sup>6</sup>	130	MW		Wednesday, November 9, 2022	2	2	1,175	1,081
Other Island Generation:	225	MW		Thursday, November 10, 2022	1	5	1,115	1,022
ML/LIL Imports:	216	MW		Friday, November 11, 2022	3	4	1,045	953
Current St. John's Temperature & Windchill:	13 °C	N/A	°C	Saturday, November 12, 2022	0	3	1,095	1,002
7-Day Island Peak Demand Forecast:	1,175	MW		Sunday, November 13, 2022	9	14	915	824

#### Supply Notes For November 07, 2022

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.
  8. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold.

### Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Sun, Nov 06, 2022	Actual Island Peak Demand <sup>9</sup>	17:05	1,134 MW
Mon, Nov 07, 2022	Forecast Island Peak Demand		1,085 MW

- Notes: 9. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).