


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Monday, November 28, 2022**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Sunday, November 27, 2022**

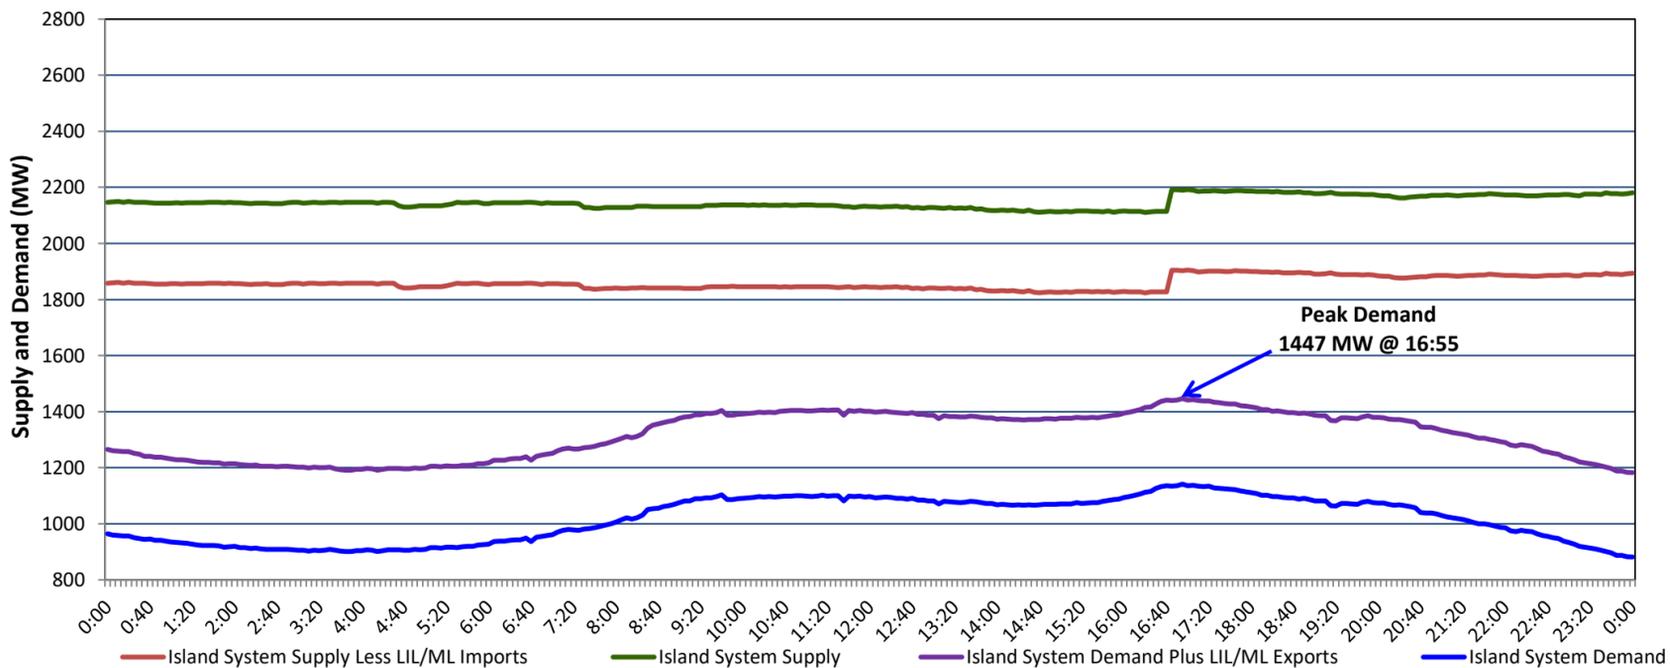

Supply Notes For November 27, 2022

- A As of 0806 hours, November 10, 2022, St. Anthony Diesel Plant available at 8.7 MW (9.7 MW).
- B As of 1638 hours, November 23, 2022, Holyrood Unit 3 available at 120 MW (150 MW).
- C As of 0144 hours, November 24, 2022, Holyrood Unit 1 available at 80 MW (170 MW).
- D At 1641 hours, November 27, 2022, Bay D'Espoir Unit 2 available (76.5 MW).

**Section 2
Island Interconnected Supply and Demand**

Mon, Nov 28, 2022	Island System Outlook ³		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	2,052	MW	Monday, November 28, 2022	2	7	1,405	1,309
NLH Island Generation: ^{4,8}	1,490	MW	Tuesday, November 29, 2022	1	-3	1,360	1,264
NLH Island Power Purchases: ⁶	80	MW	Wednesday, November 30, 2022	-4	-5	1,350	1,254
Other Island Generation:	195	MW	Thursday, December 1, 2022	0	6	1,245	1,151
ML/LIL Imports:	287	MW	Friday, December 2, 2022	3	-1	1,260	1,165
Current St. John's Temperature & Windchill:	2 °C	N/A °C	Saturday, December 3, 2022	-2	1	1,205	1,111
7-Day Island Peak Demand Forecast:	1,405	MW	Sunday, December 4, 2022	4	4	1,205	1,111

Supply Notes For November 28, 2022

- E At 0726 hours, November 28, 2022, Upper Salmon Unit unavailable due to planned outage (84 MW).

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.
 8. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Sun, Nov 27, 2022	Actual Island Peak Demand ⁹	16:55	1,447 MW
Mon, Nov 28, 2022	Forecast Island Peak Demand		1,405 MW

- Notes: 9. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).