


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Thursday, December 15, 2022**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Wednesday, December 14, 2022**

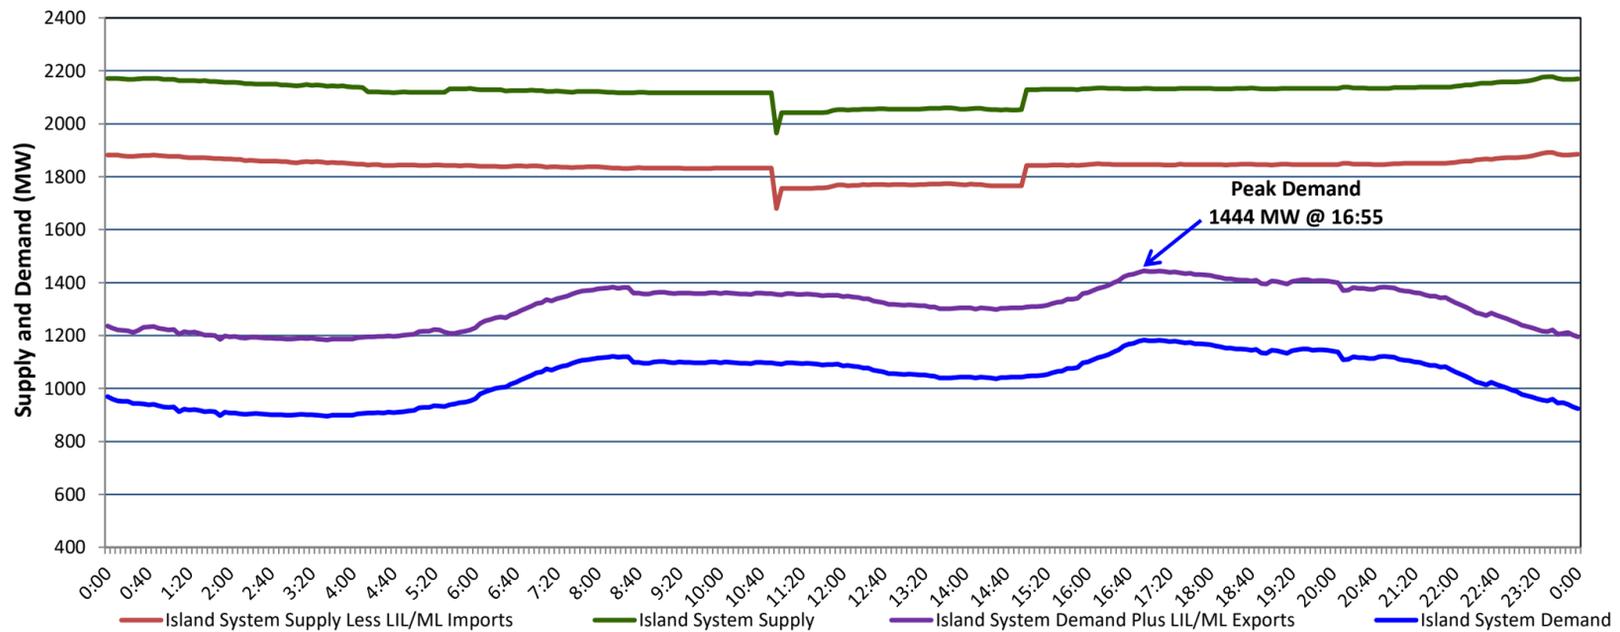

Supply Notes For December 14, 2022

- A As of 0930 hours, December 08, 2022, Holyrood Unit 1 unavailable due to planned outage 80 MW (170 MW).
- B At 1053 hours, December 14, 2022, Bay d'Espoir Unit 5 unavailable due to planned outage (76.5 MW).
- C At 1053 hours, December 14, 2022, Bay d'Espoir Unit 6 unavailable due to planned outage (76.5 MW).
- D At 1058 hours, December 14, 2022, Bay d'Espoir Unit 6 available (76.5 MW).
- E At 1315 hours, December 14, 2022, Bay d'Espoir Unit 5 available (76.5 MW).
- F At 1316 hours, December 14, 2022, Bay d'Espoir Unit 6 unavailable due to planned outage (76.5 MW).
- G At 1458 hours, December 14, 2022, Bay d'Espoir Unit 6 available (76.5 MW).

**Section 2
Island Interconnected Supply and Demand**

Thu, Dec 15, 2022	Island System Outlook ³		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	2,188	MW	Thursday, December 15, 2022	3	3	1,580	1,482
NLH Island Generation: ^{4,8}	1,525	MW	Friday, December 16, 2022	3	1	1,300	1,205
NLH Island Power Purchases: ⁶	170	MW	Saturday, December 17, 2022	1	1	1,290	1,195
Other Island Generation:	205	MW	Sunday, December 18, 2022	2	2	1,285	1,190
ML/LIL Imports:	288	MW	Monday, December 19, 2022	2	2	1,315	1,220
Current St. John's Temperature & Windchill:	3 °C	N/A °C	Tuesday, December 20, 2022	2	1	1,380	1,284
7-Day Island Peak Demand Forecast:	1,580	MW	Wednesday, December 21, 2022	2	0	1,240	1,146

Supply Notes For December 15, 2022

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.
 8. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Wed, Dec 14, 2022	Actual Island Peak Demand ⁹	16:55	1,444 MW
Thu, Dec 15, 2022	Forecast Island Peak Demand		1,580 MW

Notes: 9. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).