


Newfoundland Labrador Hydro (NLH)

Supply and Demand Status Report Filed Monday, August 25, 2025

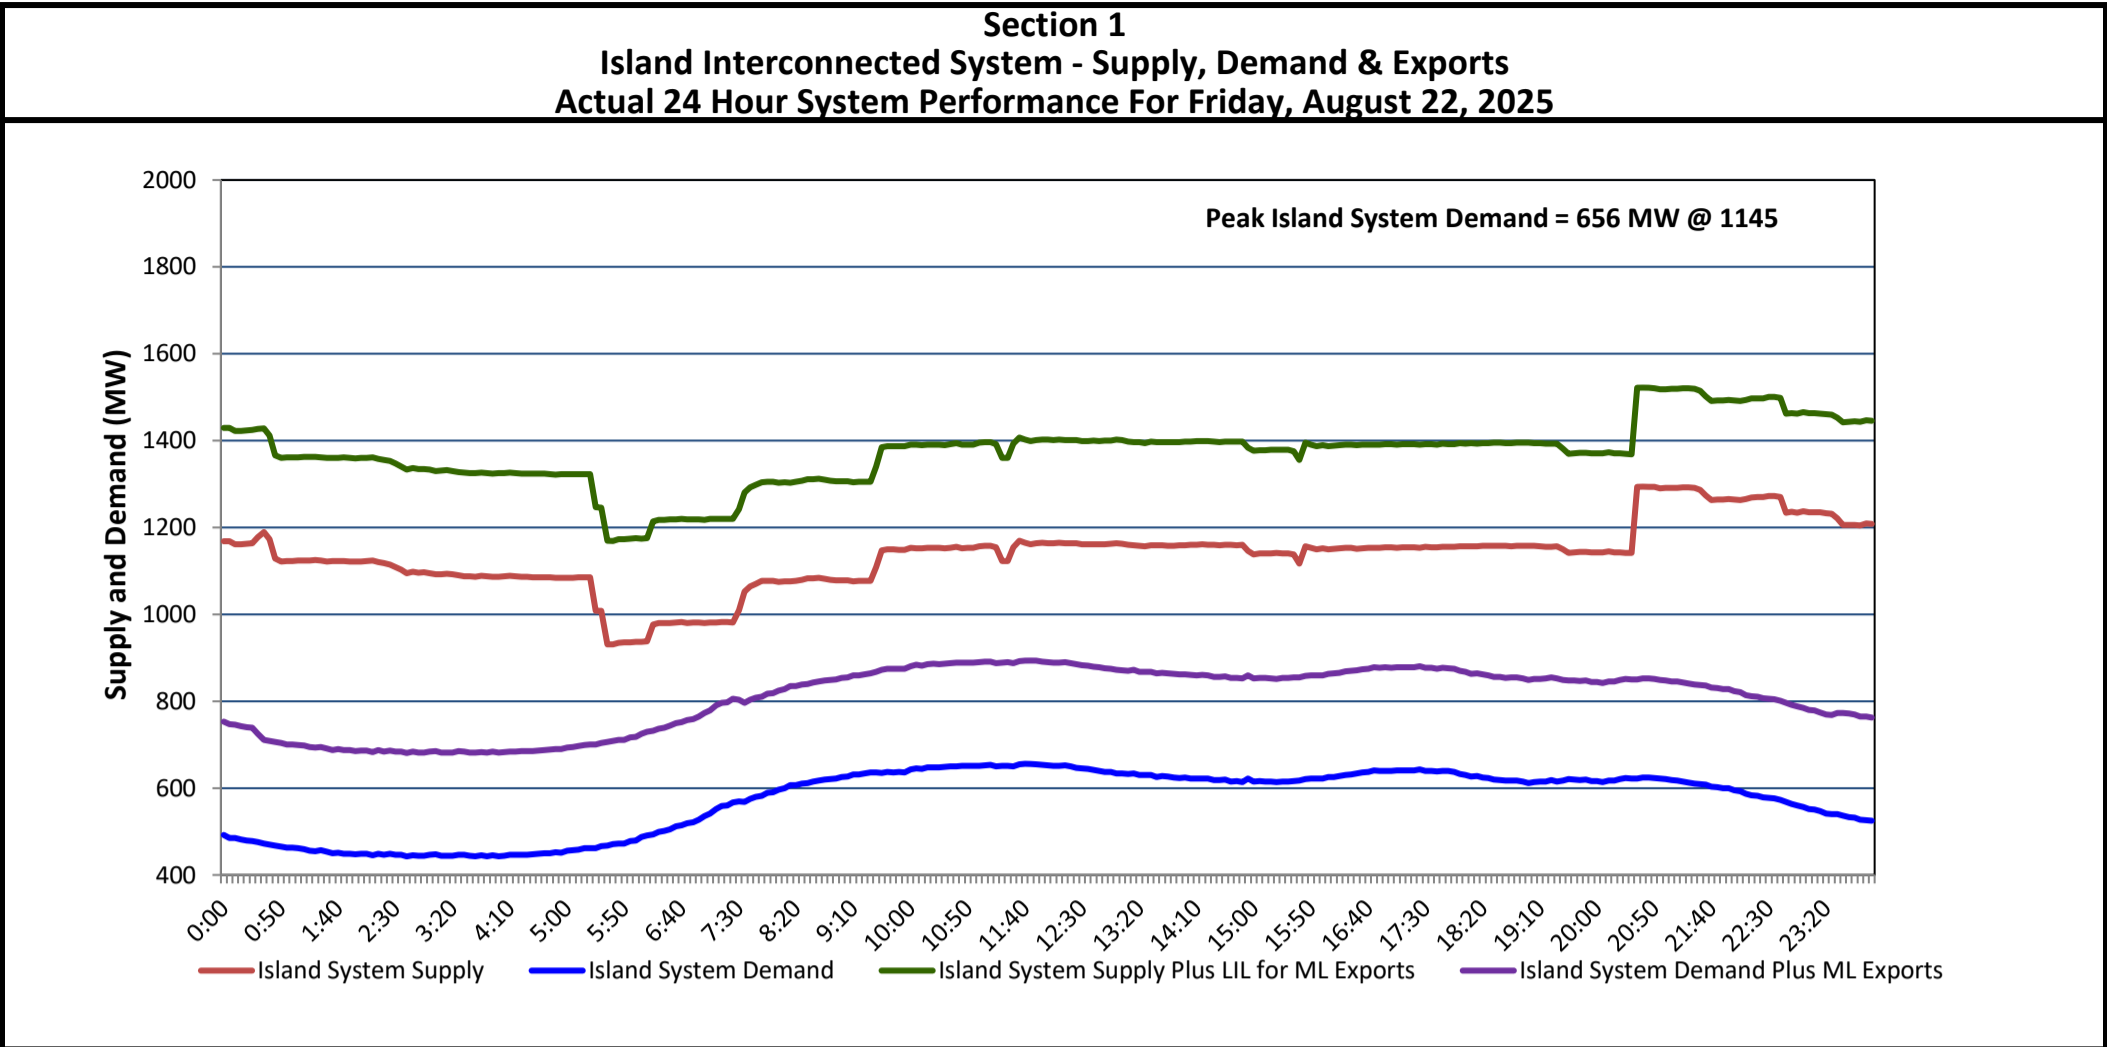

Island Supply Notes For August 22, 2025

A	As of 0800 hours, March 30, 2025, Holyrood Unit 3 unavailable due to planned outage 130 MW (150 MW).
B	As of 0823 hours, March 31, 2025, Bay d'Espoir Unit 1 unavailable due to planned outage (76.5 MW).
C	As of 0823 hours, March 31, 2025, Bay d'Espoir Unit 2 unavailable due to planned outage (76.5 MW).
D	As of 0800 hours, May 04, 2025, Holyrood Unit 1 unavailable due to planned outage (170 MW).
E	As of 0800 hours, June 08, 2025, Holyrood Unit 2 unavailable due to planned outage 115 MW (170 MW).
F	As of 1400 hours, June 29, 2025, St. Anthony Diesel Plant available at 7.7 MW due to forced derating (9.7 MW).
G	As of 0926 hours, July 21, 2025, Cat Arm Unit 2 unavailable due to planned outage (67 MW).
H	As of 0549 hours, July 24, 2025, Cat Arm Unit 1 unavailable due to planned outage (67 MW).
I	At 0521 hours, August 22, 2025, Bay d'Espoir Unit 4 unavailable due to planned outage (76.5 MW).
J	At 0534 hours, August 22, 2025, Bay d'Espoir Unit 3 unavailable due to planned outage (76.5 MW).
K	At 1542 hours, August 22, 2025, Hardwoods Gas Turbine available (50 MW).
L	At 2032 hours, August 22, 2025, Bay d'Espoir Unit 3 available (76.5 MW).
M	At 2032 hours, August 22, 2025, Bay d'Espoir Unit 4 available (76.5 MW).

Section 2

Island Interconnected System - Supply, Demand & Outlook

Sat, Aug 23, 2025	Island System Outlook ²	Seven-Day Forecast	Island System Daily Peak Demand (MW)	
			Forecast ⁸	Adjusted ⁶
Island System Supply: ⁴ NLH Island Generation: ^{3,7} NLH Island Power Purchases: ⁵ NP and CBPP Owned Generation: LIL/ML Net Imports to Island: ⁹	1,262 MW 835 MW 100 MW 180 MW 147 MW	Saturday, August 23, 2025	665	615
		Sunday, August 24, 2025	595	545
		Monday, August 25, 2025	680	630
		Tuesday, August 26, 2025	685	635
		Wednesday, August 27, 2025	675	625
7-Day Island Peak Demand Forecast:	685 MW	Thursday, August 28, 2025	660	610
		Friday, August 29, 2025	645	595

Island Supply Notes For August 23, 2025

N	At 0520 hours, August 23, 2025, Bay d'Espoir Unit 3 unavailable due to planned outage (76.5 MW).
---	--

Notes:

1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. Hydro schedules outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.

2. As of 0800 Hours.

3. Gross continuous unit output.

4. Gross output from all Island sources (including Note 3).

5. NLH Island Power Purchases include: ML Imports, Exploits Generation, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).

6. Adjusted for interruptible load and the impact of voltage reduction when applicable.

7. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine.

8. Does not include ML Exports.

9. LIL Import sunk in the Island System. Actual LIL flows will be restricted by various system conditions including, but not limited to, Island Load, ML Exports and Avalon Unit status.

Section 3

Island Peak Demand and Exports Information

Previous Day Actual Peak and Current Day Forecast Peak

Fri, Aug 22, 2025	Island Peak Demand ¹⁰	11:45	656 MW
	Exports at Peak		238 MW
	LIL Net Imports to Island		3,562 MWh
Sat, Aug 23, 2025	Forecast Island Peak Demand		665 MW

Notes:

10. Island Demand is supplied by NLH generation and purchases, LIL Imports plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).