


Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Tuesday, August 26, 2025

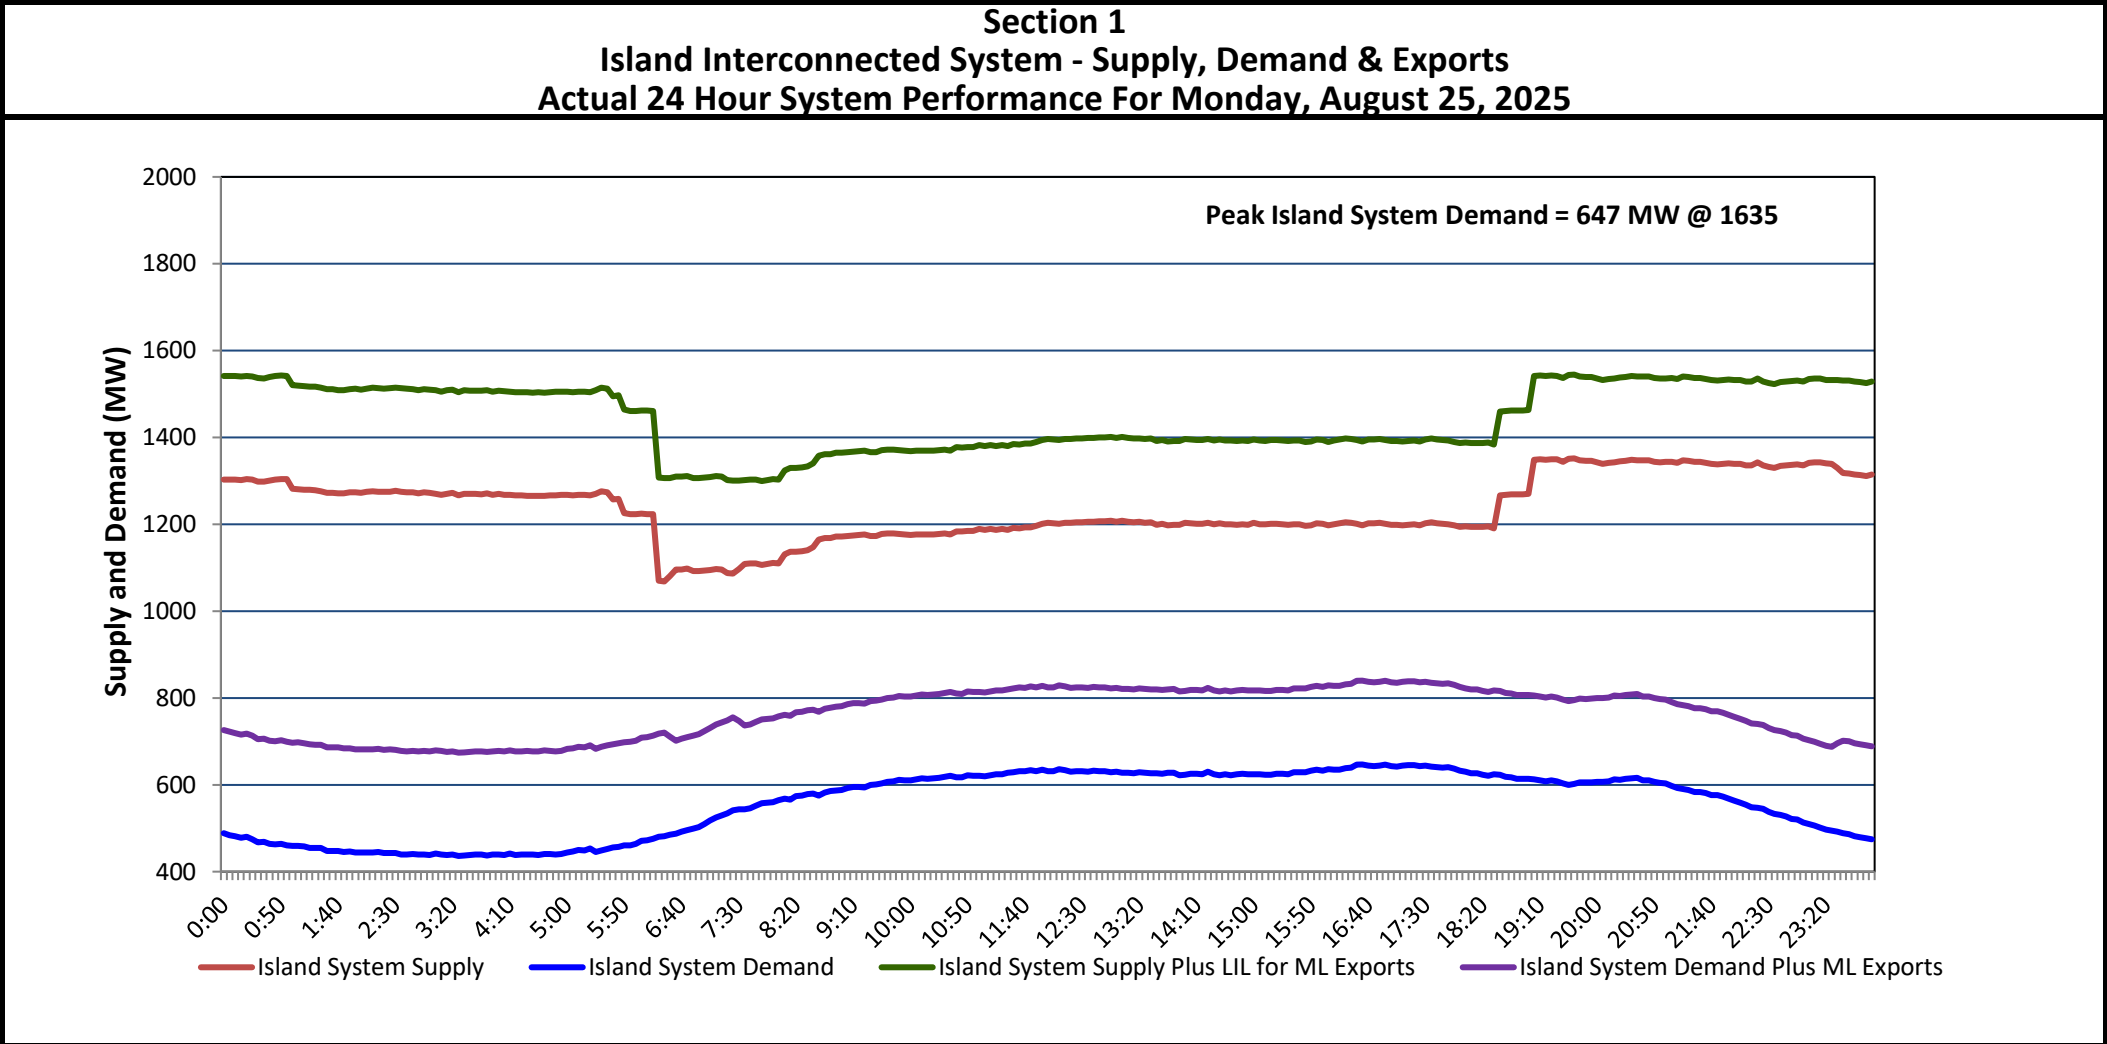

Island Supply Notes For August 25, 2025¹

A	As of 0800 hours, March 30, 2025, Holyrood Unit 3 unavailable due to planned outage 130 MW (150 MW).
B	As of 0823 hours, March 31, 2025, Bay d'Espoir Unit 1 unavailable due to planned outage (76.5 MW).
C	As of 0823 hours, March 31, 2025, Bay d'Espoir Unit 2 unavailable due to planned outage (76.5 MW).
D	As of 0800 hours, May 04, 2025, Holyrood Unit 1 unavailable due to planned outage (170 MW).
E	As of 0800 hours, June 08, 2025, Holyrood Unit 2 unavailable due to planned outage 115 MW (170 MW).
F	As of 1400 hours, June 29, 2025, St. Anthony Diesel Plant available at 7.7 MW due to forced derating (9.7 MW).
G	As of 0926 hours, July 21, 2025, Cat Arm Unit 2 unavailable due to planned outage (67 MW).
H	As of 0549 hours, July 24, 2025, Cat Arm Unit 1 unavailable due to planned outage (67 MW).
I	At 0616 hours, August 25, 2025, Bay d'Espoir Unit 4 unavailable due to planned outage (76.5 MW).
J	At 0616 hours, August 25, 2025, Bay d'Espoir Unit 5 unavailable due to planned outage (76.5 MW).
K	At 1835 hours, August 25, 2025, Bay d'Espoir Unit 5 available (76.5 MW).
L	At 1902 hours, August 25, 2025, Bay d'Espoir Unit 4 available (76.5 MW).

Section 2
Island Interconnected System - Supply, Demand & Outlook

Tue, Aug 26, 2025	Island System Outlook ²	Seven-Day Forecast	Island System Daily Peak Demand (MW)	
			Forecast ⁸	Adjusted ⁶
Island System Supply: ⁴ NLH Island Generation: ^{3,7} NLH Island Power Purchases: ⁵ NP and CBPP Owned Generation: LIL/ML Net Imports to Island: ⁹	1,401 MW 915 MW 95 MW 180 MW 211 MW	Tuesday, August 26, 2025	665	615
		Wednesday, August 27, 2025	620	570
		Thursday, August 28, 2025	645	595
		Friday, August 29, 2025	630	580
		Saturday, August 30, 2025	630	580
7-Day Island Peak Demand Forecast:	665 MW	Sunday, August 31, 2025	635	585
		Monday, September 1, 2025	655	605

Island Supply Notes For August 26, 2025

Notes:	1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. Hydro schedules outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted. 2. As of 0800 Hours. 3. Gross continuous unit output. 4. Gross output from all Island sources (including Note 3). 5. NLH Island Power Purchases include: ML Imports, Exploits Generation, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable). 6. Adjusted for interruptible load and the impact of voltage reduction when applicable. 7. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine. 8. Does not include ML Exports. 9. LIL Import sunk in the Island System. Actual LIL flows will be restricted by various system conditions including, but not limited to, Island Load, ML Exports and Avalon Unit status.
--------	---

Section 3
Island Peak Demand and Exports Information
Previous Day Actual Peak and Current Day Forecast Peak

Mon, Aug 25, 2025	Island Peak Demand ¹⁰ Exports at Peak LIL Net Imports to Island	16:35	647 MW 193 MW 4,778 MWh
Tue, Aug 26, 2025	Forecast Island Peak Demand		665 MW

Notes: 10. Island Demand is supplied by NLH generation and purchases, LIL Imports plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).