


Newfoundland Labrador Hydro (NLH)

Supply and Demand Status Report Filed Tuesday, November 04, 2025

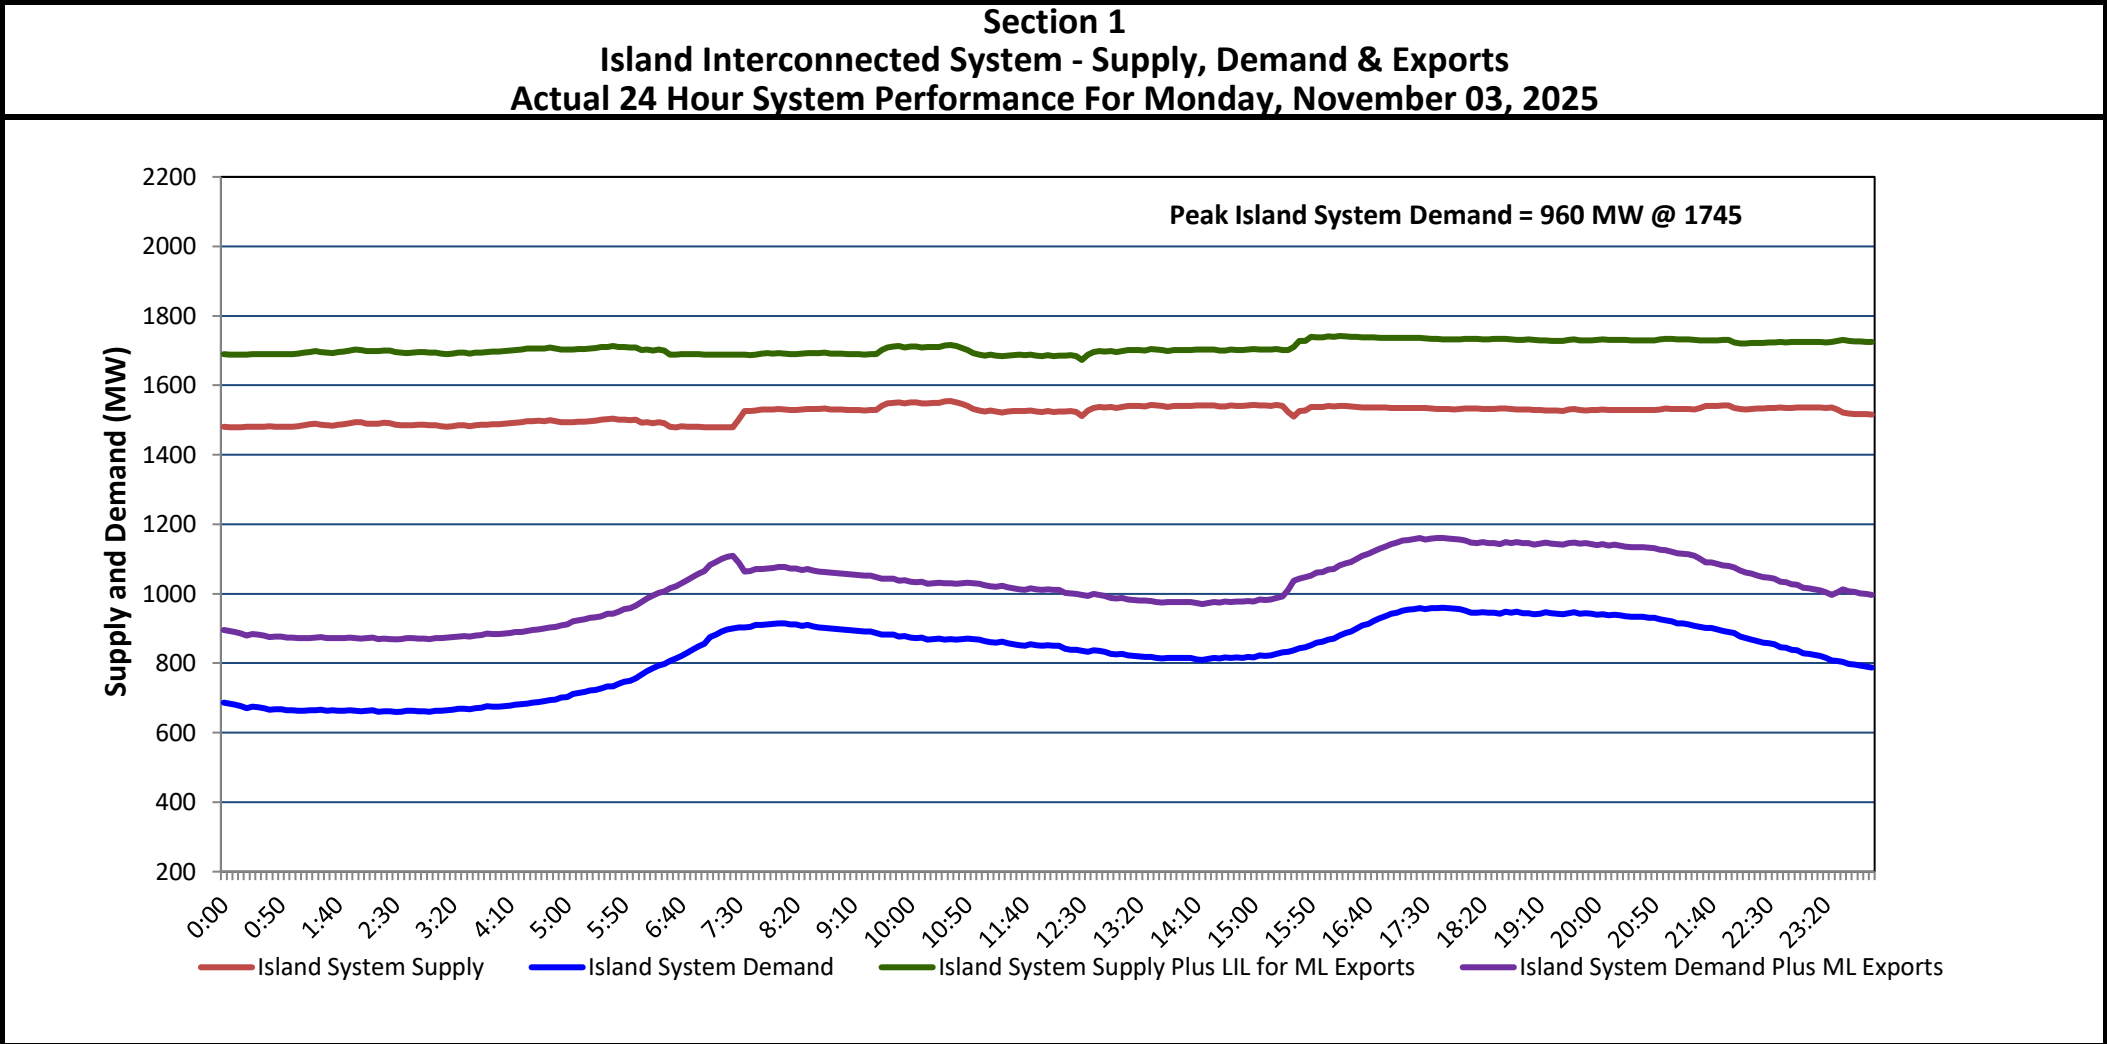

Island Supply Notes For November 03, 2025¹

A

As of 0800 hours, March 30, 2025, Holyrood Unit 3 unavailable due to planned outage 130 MW (150 MW).

B

As of 0823 hours, March 31, 2025, Bay d'Espoir Unit 1 unavailable due to planned outage (76.5 MW).

C

As of 0823 hours, March 31, 2025, Bay d'Espoir Unit 2 unavailable due to planned outage (76.5 MW).

D

As of 1502 hours, October 09, 2025, Holyrood Unit 1 available at 100 MW due to forced derating (170 MW).

E

As of 1405 hours, October 23, 2025, Holyrood Unit 2 available at 163 MW due to forced derating (170 MW).

F

As of 1600 hours, October 27, 2025, Holyrood Gas Turbine unavailable due to forced outage (123.5 MW).

G

As of 1320 hours, November 01, 2025, St. Anthony Diesel Plant available at 5.7 MW due to forced derating (9.7 MW).

H

As of 0846 hours, November 02, 2025, Hinds Lake Unit unavailable due to planned outage (75 MW).

Section 2

Island Interconnected System - Supply, Demand & Outlook

Tue, Nov 04, 2025	Island System Outlook ²	Seven-Day Forecast	Island System Daily Peak Demand (MW)	
			Forecast ⁸	Adjusted ⁶
Island System Supply: ⁴ NLH Island Generation: ^{3,7} NLH Island Power Purchases: ⁵ NP and CBPP Owned Generation: LIL/ML Net Imports to Island: ⁹	1,545 MW	Tuesday, November 4, 2025	1,005	913
	1,110 MW	Wednesday, November 5, 2025	1,020	928
	30 MW	Thursday, November 6, 2025	1,000	908
	125 MW	Friday, November 7, 2025	1,065	973
	280 MW	Saturday, November 8, 2025	1,025	933
7-Day Island Peak Demand Forecast:	1,065 MW	Sunday, November 9, 2025	935	844
		Monday, November 10, 2025	1,000	908

Island Supply Notes For November 04, 2025

Notes:

1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. Hydro schedules outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.

2. As of 0800 Hours.

3. Gross continuous unit output.

4. Gross output from all Island sources (including Note 3).

5. NLH Island Power Purchases include: ML Imports, Exploits Generation, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).

6. Adjusted for interruptible load and the impact of voltage reduction when applicable.

7. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine.

8. Does not include ML Exports.

9. LIL Import sunk in the Island System. Actual LIL flows will be restricted by various system conditions including, but not limited to, Island Load, ML Exports and Avalon Unit status.

Section 3

Island Peak Demand and Exports Information

Previous Day Actual Peak and Current Day Forecast Peak

Mon, Nov 03, 2025	Island Peak Demand ¹⁰	17:45	960 MW
	Exports at Peak		201 MW
	LIL Net Imports to Island		5,764 MWh
Tue, Nov 04, 2025	Forecast Island Peak Demand		1,005 MW

Notes:

10. Island Demand is supplied by NLH generation and purchases, LIL Imports plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).