

1 Q. **Reference: Reliability and Resource Adequacy Study 2021 Update - Volume II: Near-Term**
2 **Reliability (2021 RRAS Update) page 19, Figure 1.**

3 Update Figure 1 to show total system energy storage for the most recent available date.

4

5

6 A. Figure 1 plots the 2020 and 2021 storage levels, minimum storage limits, maximum operating
7 level storage, and the 20-year average aggregate storage for comparison.

8 The aggregate reservoir storage level on September 20, 2021 was 1,602 GWh. The current
9 storage level is shown in Figure 1 in relation to both 2020 storage and the 20-year average
10 storage level. Newfoundland and Labrador Hydro will provide another update with data to the
11 end of September in its next Monthly Energy Supply Report, scheduled to be filed on
12 October 18, 2021.

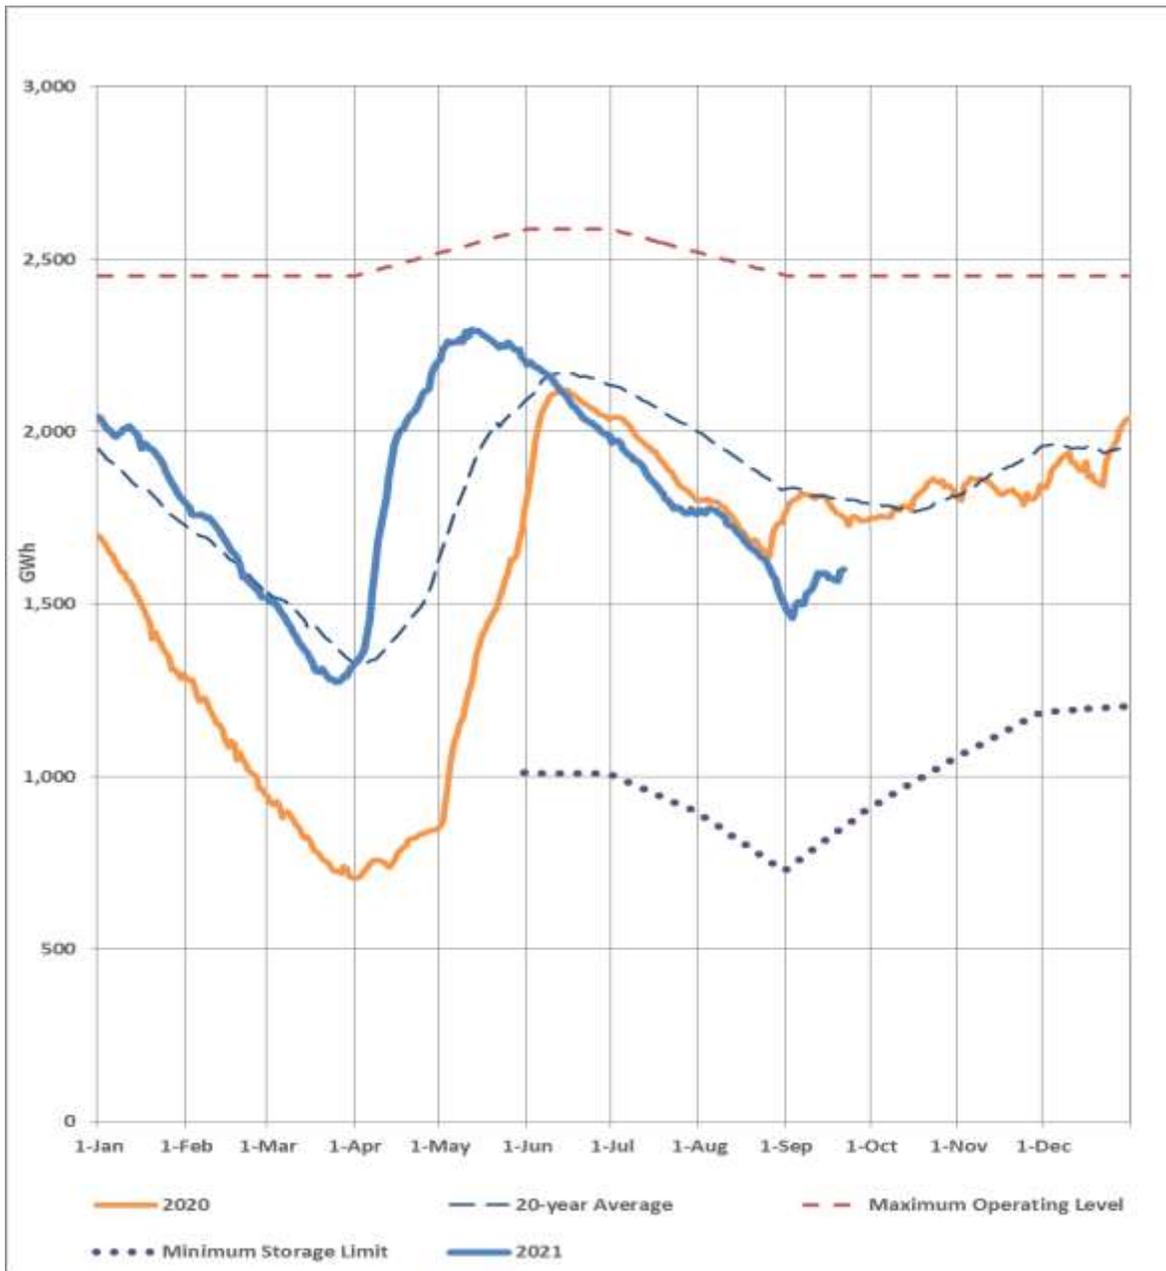


Figure 1: Total System Energy Storage